


PLAN VIEW

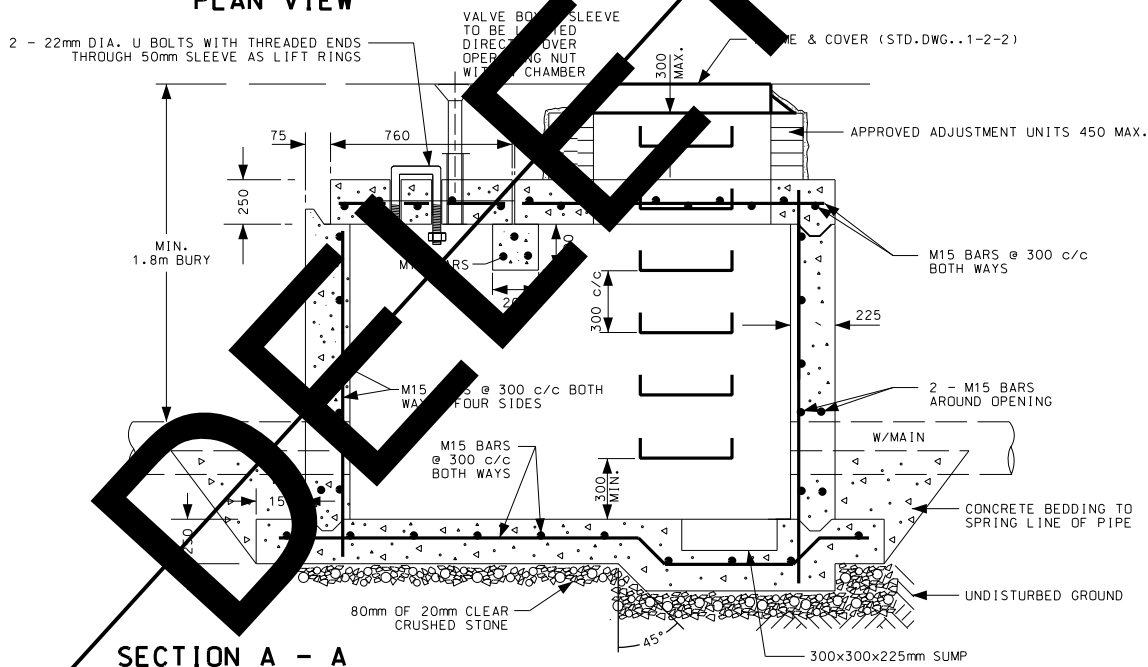

SECTION A - A

NOTES

1. CONCRETE STRENGTH TO BE 30 MPa, MIN. COVER TO REINFORCEMENT TO BE 50mm.
2. POLYETHELENE BOND BREAKER TO BE USED BETWEEN CONCRETE AND FITTINGS.
3. CONCRETE VALVE SUPPORT ON VALVE TO BE A MIN. OF 230mm.
4. APPROVED ADJUSTMENT UNITS TO BE INSTALLED AS PER MANUFACTURERS INSTRUCTIONS
5. JOINT AROUND REMOVABLE SLAB TO BE SEALED AS SPECIFIED.
6. STEEL SHOWN IS TYPICAL ONLY, ACTUAL REINFORCEMENT AS PER SITE SPECIFIC REQUIREMENTS AND AS PER THE DESIGNERS REQUIREMENTS.



**PUBLIC WORKS
STANDARD DRAWING**

REV. DATE: MAY 2009

APPROVED BY

DRAWN BY

R.S.

T.J.

STD. DWG. NUMBER

SCALE

1-1-2

N.T.S.

SMALL CAST-IN-PLACE CHAMBER