


STANDPIPE DETAIL

TABLE

PIPE SIZE IN	METER SIZE	PIPE SIZE OUT	'A'
38mm	25mm	38mm	273mm
50mm	38mm	50mm	330mm
75mm	50mm	75mm	432mm
100mm	75mm	75mm	432mm
—	75mm STRAINER	—	152mm

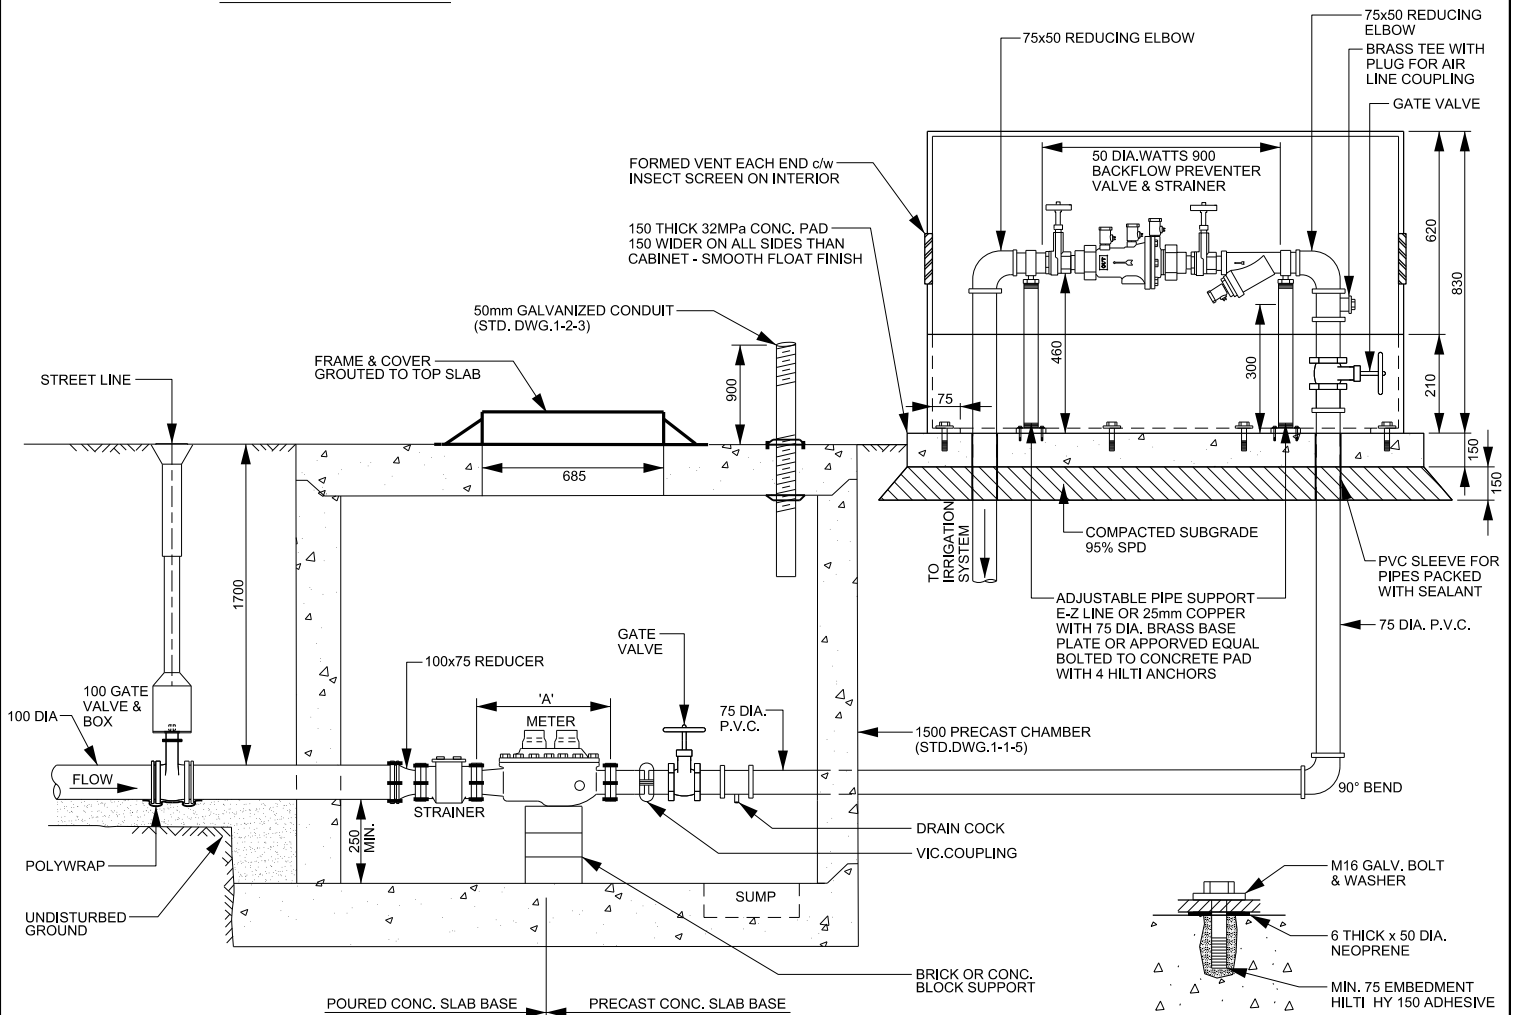

ANCHOR DETAIL

NOTE

1. IF METER SIZE IS LESS THAN 75mm, THEN A TEST OUTLET GATE VALVE SHALL BE INSTALLED (STD.1-4-6) ON OUTLET SIDE OF METER.
2. ABOVE GRADE UTILITY BOX TO BE HEAVY DUTY 125 GAUGE ALUMINUM WELDED DAMOND PATTERN CABINET COMPLETE WITH GALVANIZED STEEL LOCKING HASP 130mm LONG, CENTRED ON CABINET.
3. IRRIGATION SYSTEM TO BE WINTERIZED TO ELIMINATE PROBABLE FREEZING AND BURSTING OF PIPES.
4. ALL INTERNAL AND EXTERNAL VALVES, FITTINGS, THROUGH WALL METAL PIPING AND MECHANICAL RESTRAINTS TO BE c/w DENSO PASTE, DENSO MASTIC AND DENSO TAPE OR APPROVED EQUAL, APPLIED TO MANUFACTURER'S RECOMMENDATIONS.



PUBLIC WORKS  
STANDARD DRAWING

REV. DATE: NOVEMBER 2011

APPROVED BY

DRAWN BY

A.L.

AINLEY GROUP

METER CHAMBER FOR IRRIGATION SYSTEM  
IN ABOVE GRADE UTILITY BOX

STD. DWG. NUMBER

SCALE

1-4-17A

N.T.S.