


TYPICAL WATERPROOF DIRECT BURY LUG CONNECTION


ALL TRACER WIRE TO BE 12 GAUGE STRANDED COPPER

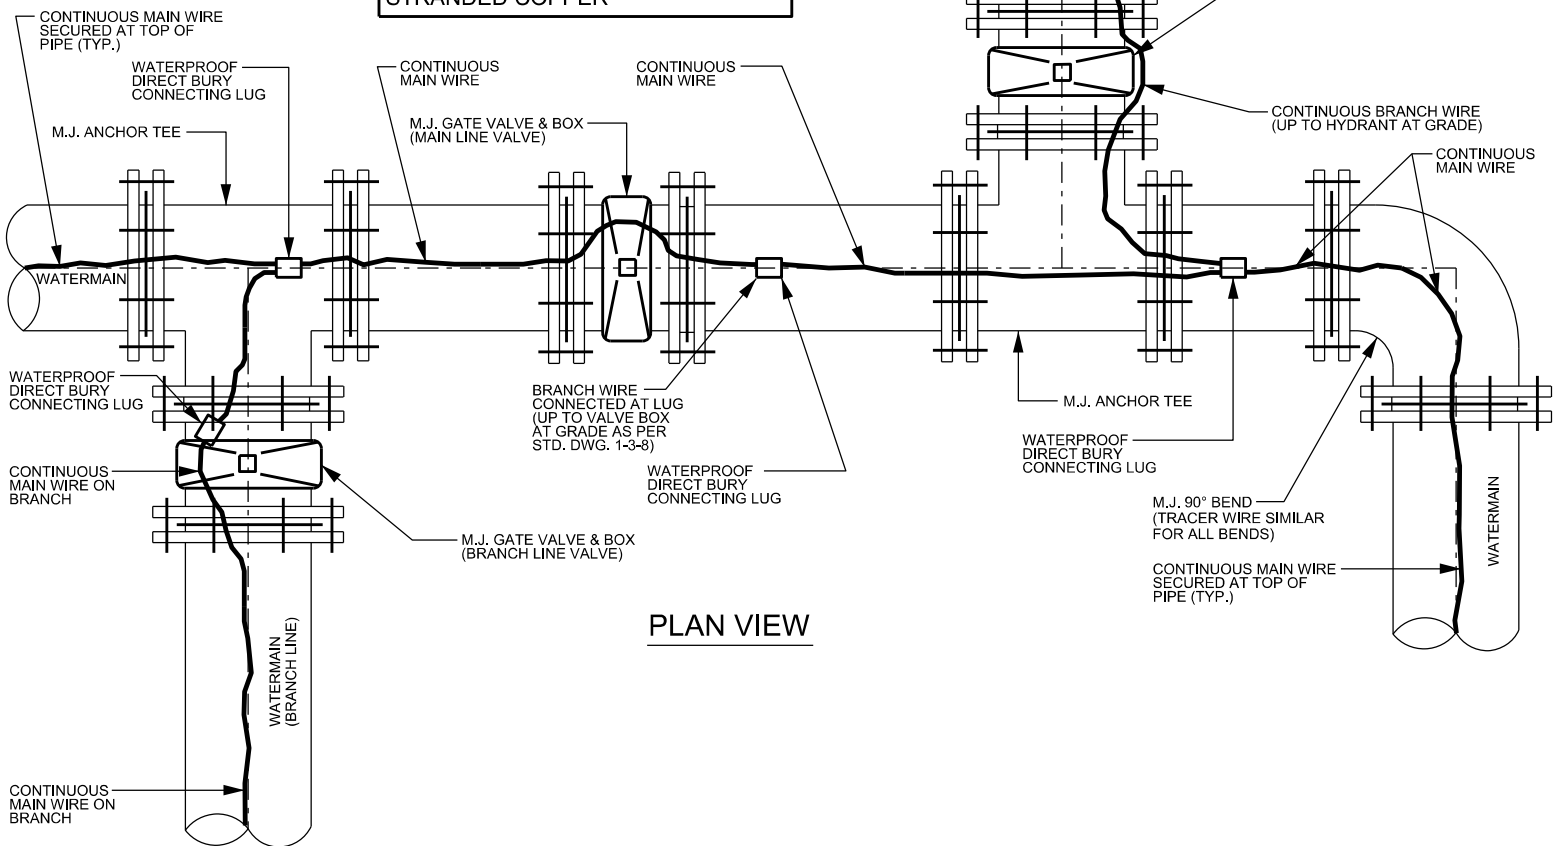

PLAN VIEW

NOTE

1. REFER TO STD. DWG. 1-3-8 FOR TRACER WIRE INSTALLATION AT VALVE BOXES AND STD. DWGS. 1-6-1, 1-6-2 FOR TRACER WIRE INSTALLATION AT HYDRANTS.
2. ALL PIPING, FITTINGS, VALVES, APPURTENANCES AND MECHANICAL RESTRAINTS TO BE PROTECTED WITH 3 PART CORROSION PREVENTION SYSTEM, APPLIED TO MANUFACTURER'S RECOMMENDATIONS.
3. TRACER WIRE TO BE SECURED TO THE TOP OF THE PIPE AT NO MORE THAN 2.0m INTERVALS.

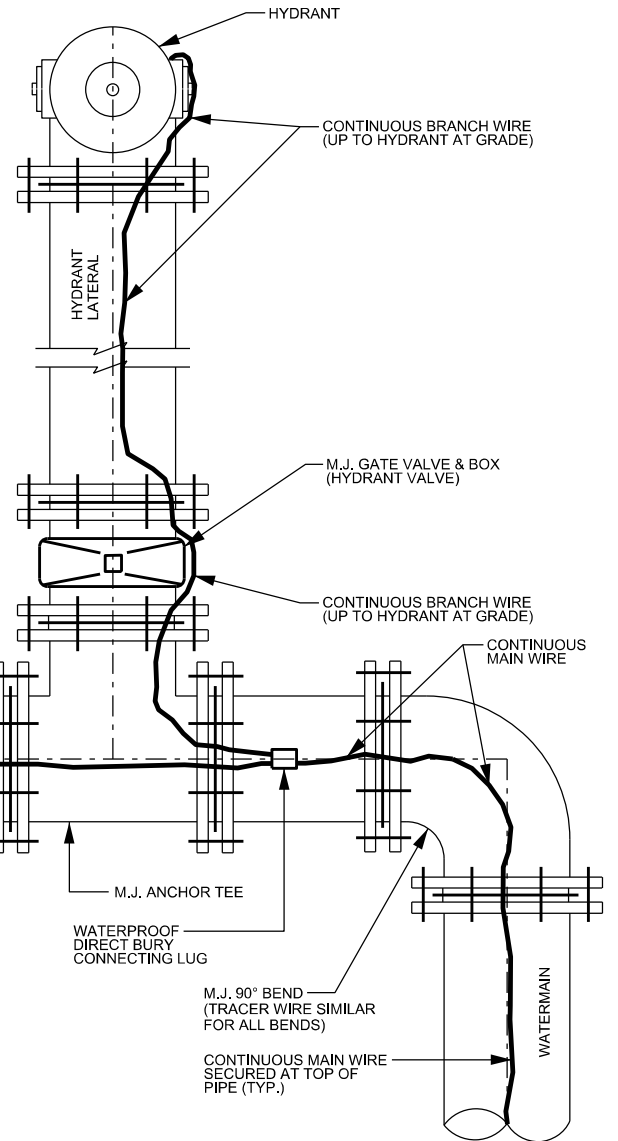

PUBLIC WORKS
STANDARD DRAWING

REV. DATE: MARCH 2018

APPROVED BY

DRAWN BY

E.O.

AINLEY GROUP

STD. DWG. NUMBER

SCALE

1-7-10

N.T.S.

TYPICAL TRACER WIRE INSTALLATION FOR
WATERMAIN VALVES, HYDRANTS AND TEES