

NOTE:

WATER

BOTH INDIVIDUAL CONNECTIONS OR BULK METERED CONNECTION ARE PERMISSIBLE


SEWERS

CONDOMINIUMS

MUST HAVE WYED LATERAL c/w SAMPLE MH'S PROVIDING EACH UNIT ITS OWN LATERAL

RENTALS

ONE LATERAL WITH SAMPLE MH CAN SERVICE TOTAL RENTAL UNITS

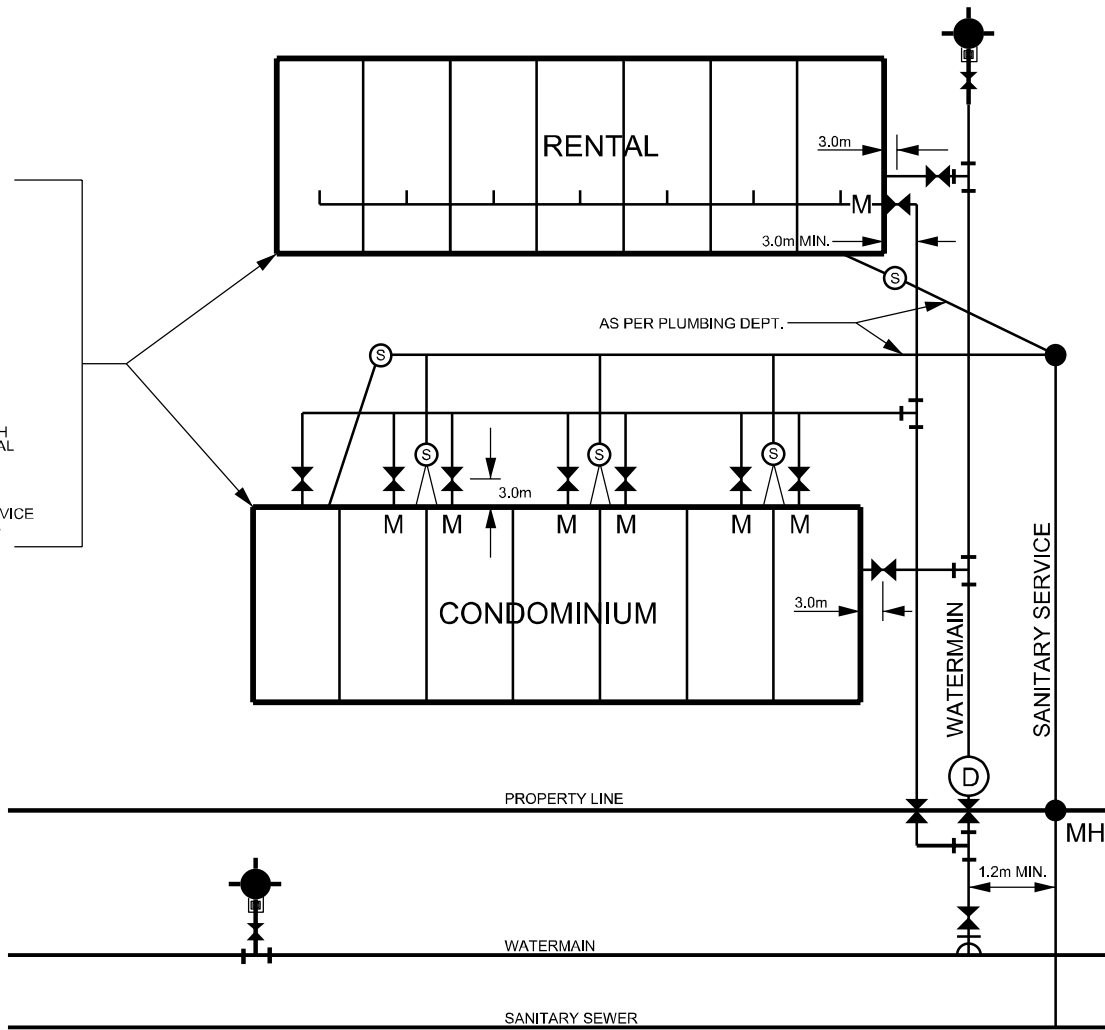

NOTE:

MH's ALONG SEWER GOVERNED BY PLUMBING CODE

LEGEND

- VALVE & BOX
- DETECTOR CHECK VALVE IN CHAMBER
- CHECK VALVE IN CHAMBER
- TAPPING SLEEVE & VALVE & BOX
- TEE
- FIRE HYDRANT C/W VALVE & BOX
- DIRECTION OF PUMPER NOZZLE
- METER IN CHAMBER
- METER
- SAMPLING SANITARY MAINTENANCE HOLE
- NON-SAMPLING SANITARY MAINTENANCE HOLE

NOTE

1. PROTECTUS METER SHALL BE USED FOR PRIVATE HYDRANTS ON A BULK METER SYSTEM
2. SAMPLING MANHOLE TO BE PROVIDED TO EACH BUILDING WITH A DIFFERENT MUNICIPAL ADDRESS OR OWNERSHIP
3. MAINTENANCE HOLE TO BE PLACED AT ALL JUNCTIONS (PLUMBING CODE 1997)



**PUBLIC WORKS
STANDARD DRAWING**

REV. DATE: NOVEMBER 2011

APPROVED BY

A.P.

STD. DWG. NUMBER

1-8-9

DRAWN BY

AINLEY GROUP

SCALE

N.T.S.

**SERVICING FOR MULTIPLE BUILDING INDUSTRIAL
SITES (NO FRONTAGE)**