

LAKEVIEW WATER TREATMENT PLANT


a. Total Monthly Volumes

Table 1: 2018 Lakeview Total Monthly Water Volumes

Month	Volume (ML)	
	Raw Water	Treated Water
January	10,369	9,866
February	9,585	9,073
March	11,133	10,520
April	11,287	10,524
May	12,557	11,786
June	14,811	14,170
July	17,314	16,490
August	15,670	14,945
September	13,722	12,940
October	11,903	11,287
November	11,262	10,795
December	11,580	11,060
Annual Total	151,193	143,456

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 1: 2018 Lakeview Total Monthly Water Volumes

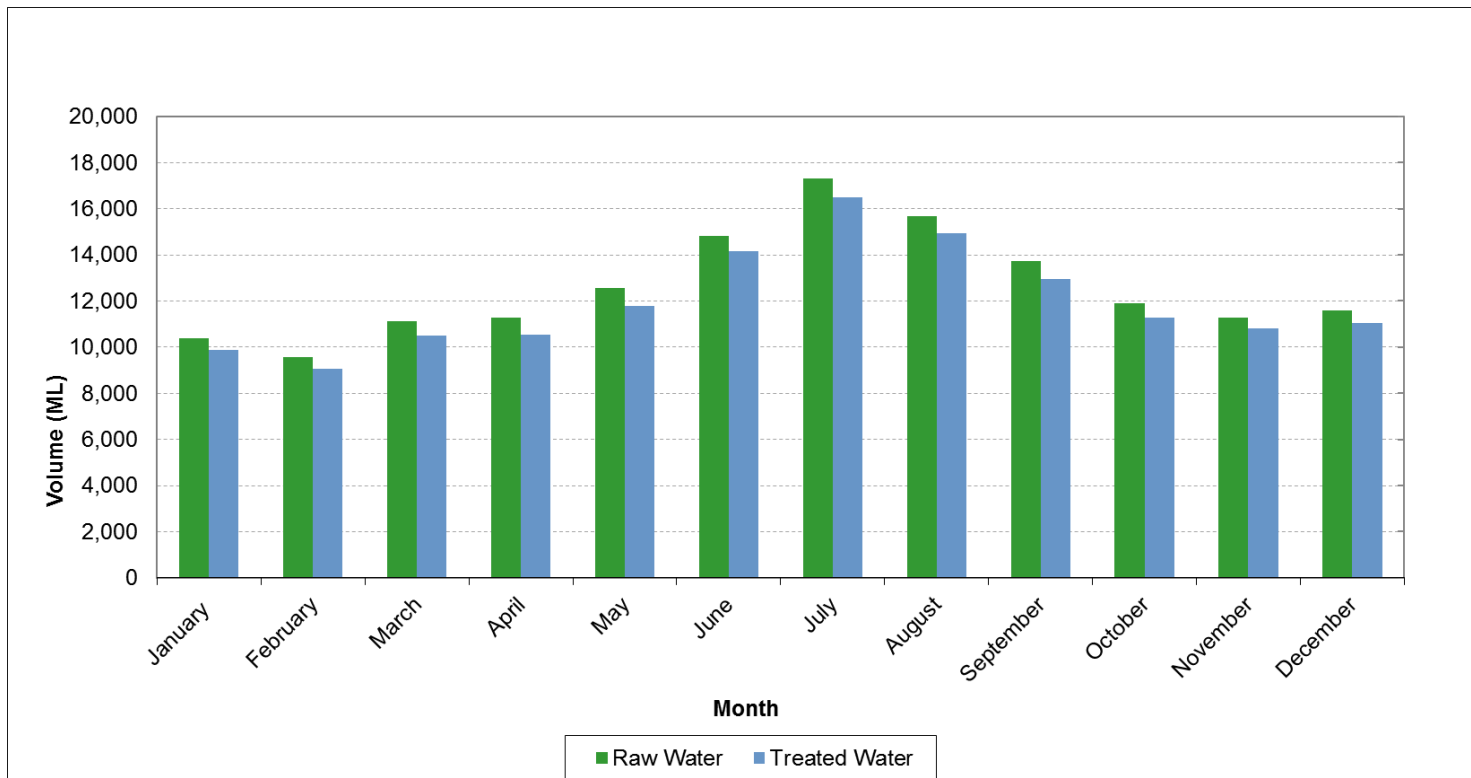


b. Average Daily Production

Table 2: 2018 Lakeview Average Daily Water Production

Month	Average Total Daily Flow (ML/Day)	
	Raw Water	Treated Water
January	334	318
February	342	324
March	359	339
April	376	351
May	405	380
June	494	472
July	559	532
August	505	482
September	457	431
October	384	364
November	375	360
December	374	357
Annual Average	414	393

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 2: 2018 Lakeview Average Daily Water Production

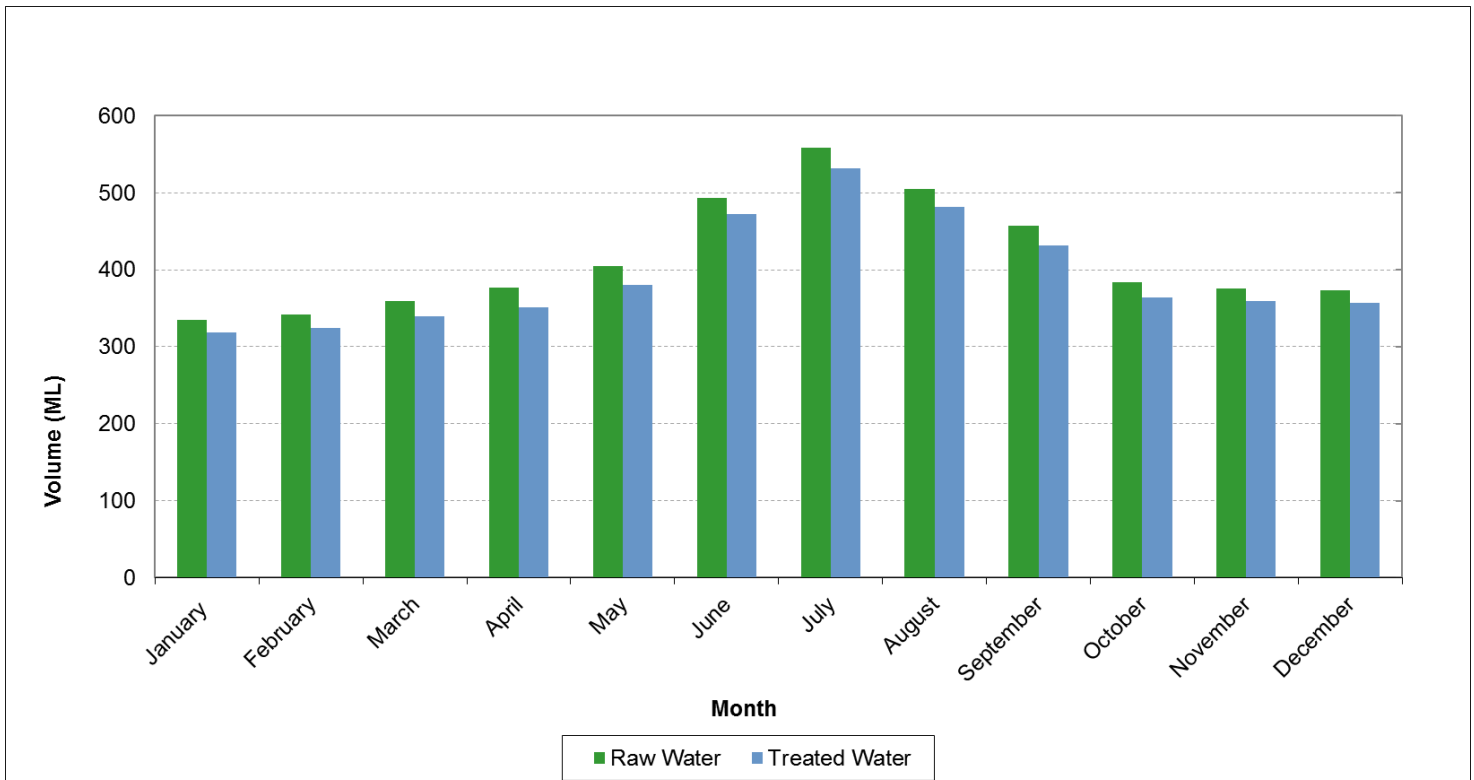


c. Maximum Daily Raw Water Volumes and Permit to Take Water (PTTW) Limits

Table 3: 2018 Lakeview Maximum Daily Raw Water Volumes

Month	Volume (ML/Day)
January	424
February	386
March	450
April	490
May	559
June	657
July	681
August	628
September	548
October	466
November	457
December	483

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 3: 2018 Lakeview Maximum Daily Raw Water Volumes

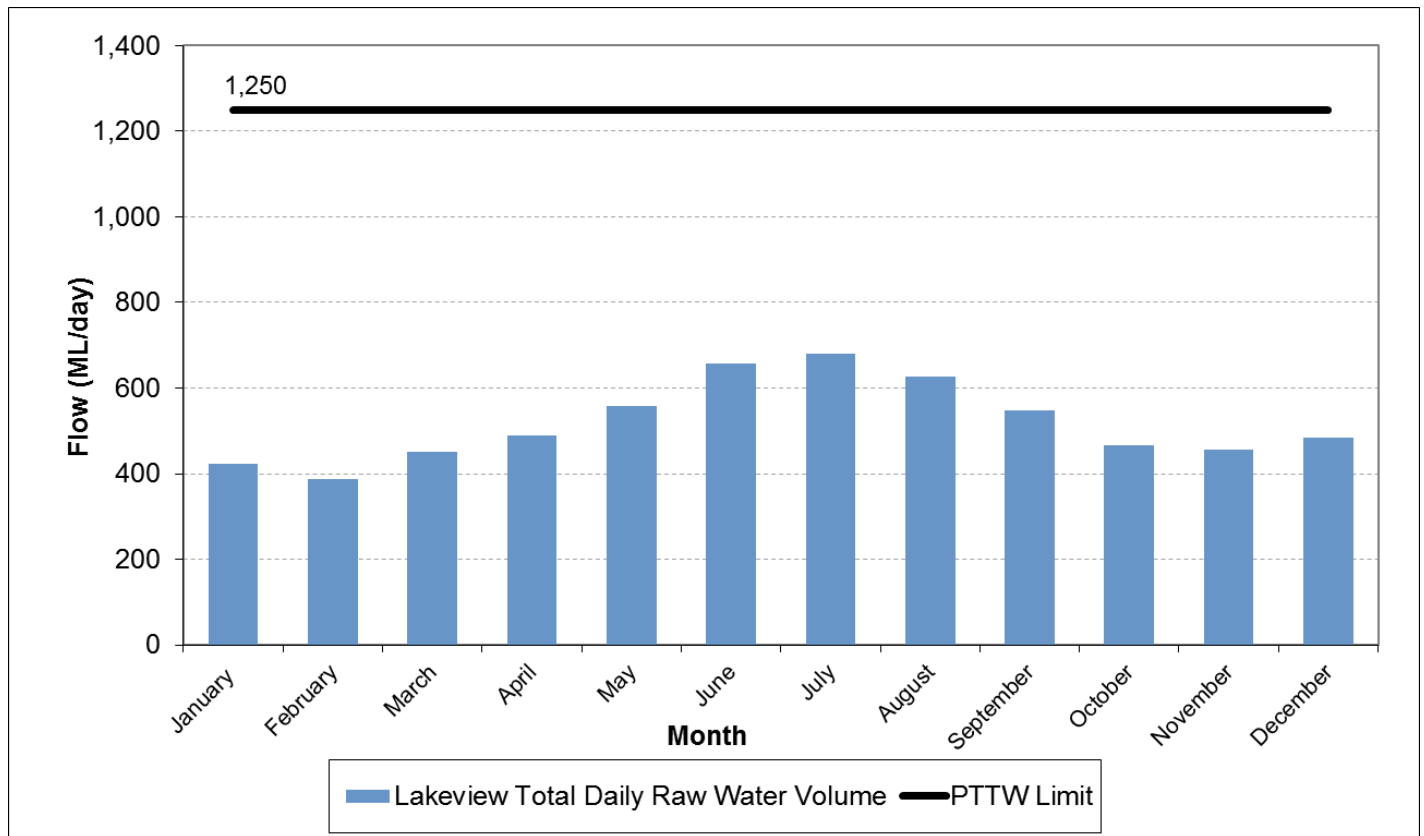


d. Maximum Daily Production and Municipal Drinking Water Licence (MDWL) Limits

Table 4: 2018 Lakeview Maximum Daily Treated Water Volumes

Month	Production (ML/Day)
January	401
February	369
March	419
April	451
May	517
June	632
July	647
August	593
September	522
October	454
November	441
December	454

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 4: 2018 Lakeview Maximum Daily Treated Water Production

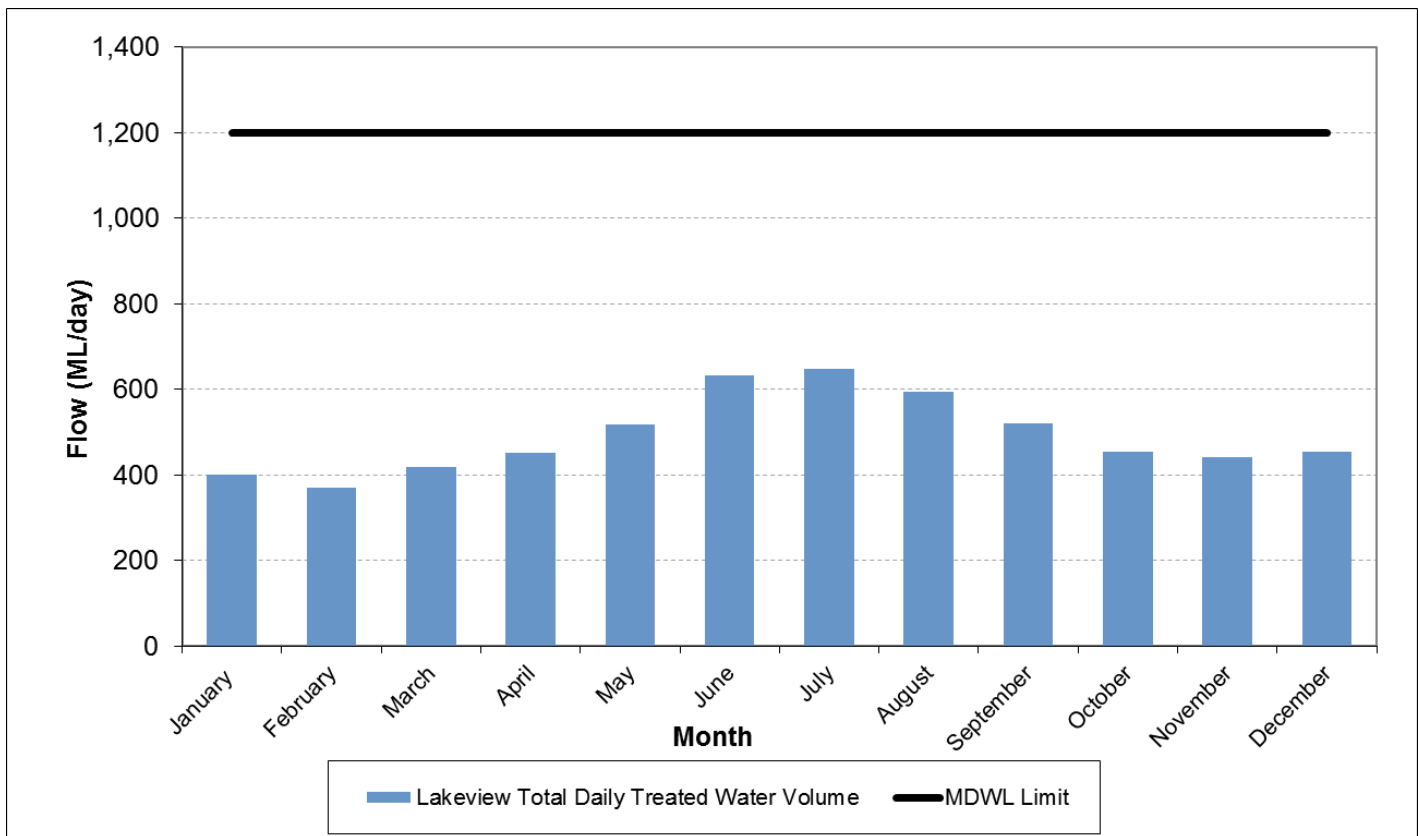

LORNE PARK WATER TREATMENT PLANT


a. Total Monthly Volumes

Table 5: 2018 Lorne Park Total Monthly Water Volumes

Month	Volume (ML)	
	Raw Water	Treated Water
January	6,599	6,158
February	5,603	5,277
March	6,344	6,028
April	5,652	5,118
May	6,906	6,248
June	7,441	6,842
July	7,711	7,197
August	7,348	6,843
September	7,077	6,622
October	6,658	6,137
November	6,254	5,642
December	5,700	5,128
Annual Total	79,293	73,241

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 5: 2018 Lorne Park Total Monthly Water Volumes

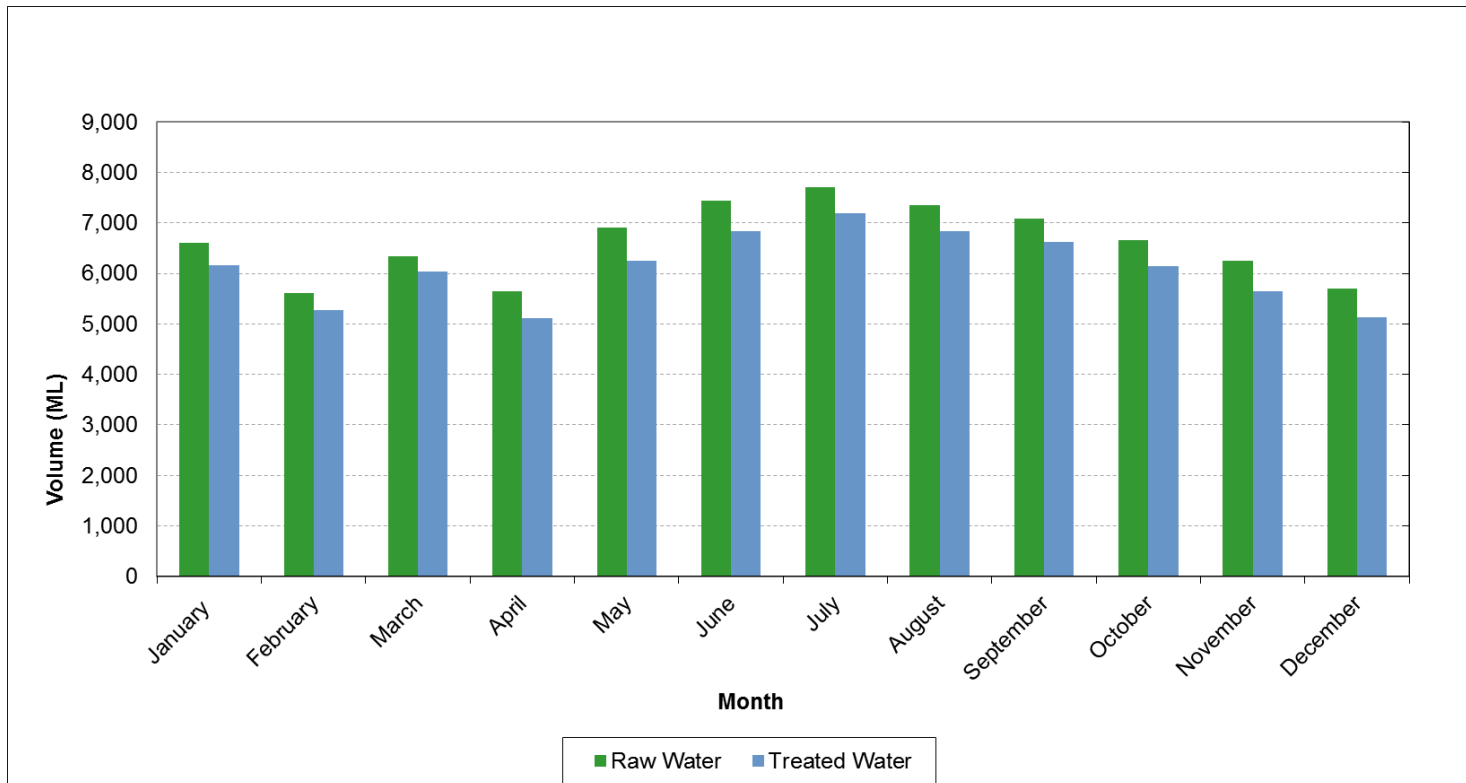


b. Average Daily Production

Table 6: 2018 Lorne Park Average Daily Water Production

Month	Average Total Daily Flow (ML/Day)	
	Raw Water	Treated Water
January	213	199
February	200	188
March	205	194
April	188	171
May	223	202
June	248	228
July	249	232
August	237	221
September	236	221
October	215	198
November	208	188
December	184	165
Annual Average	217	201

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 6: 2018 Lorne Park Average Daily Water Production

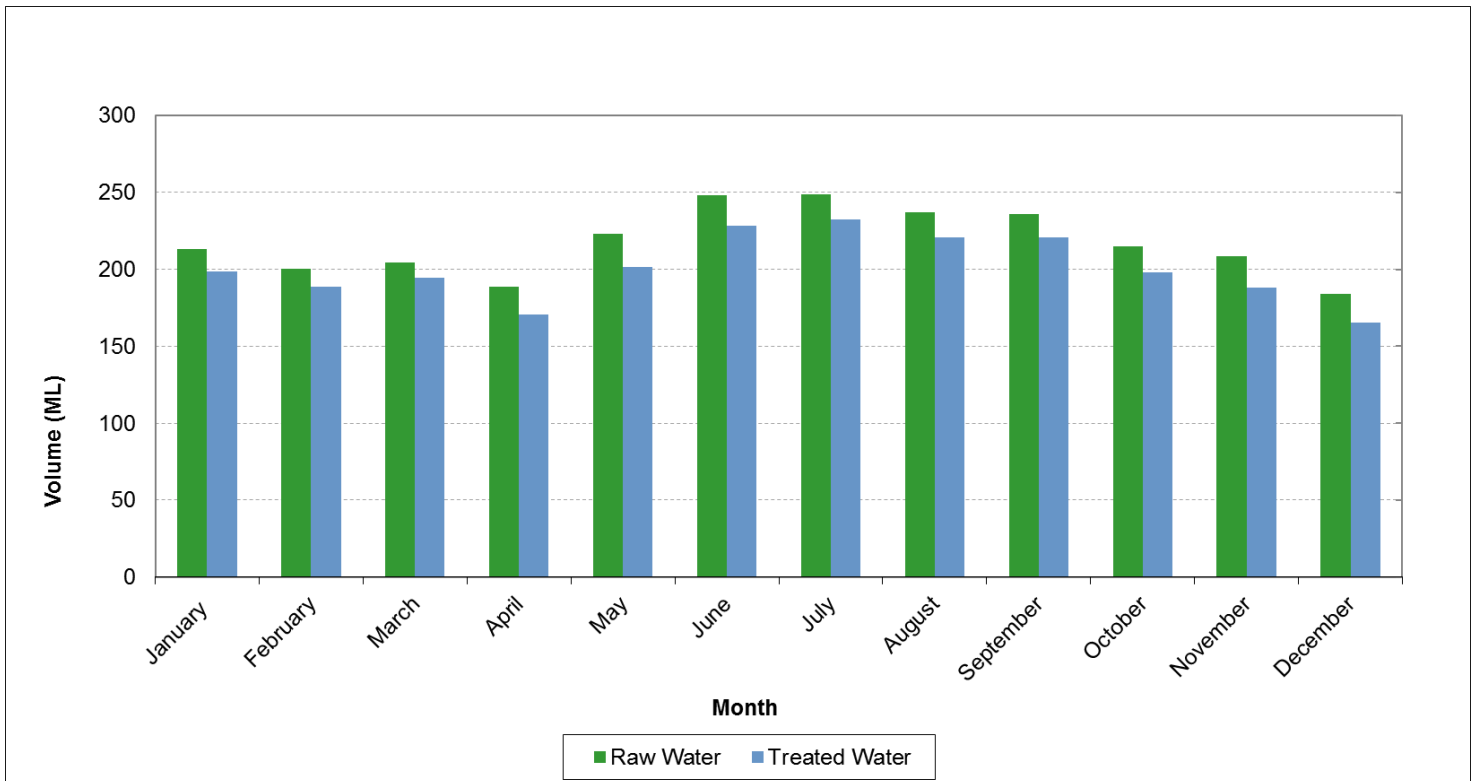


c. Maximum Daily Raw Water Volumes and Permit to Take Water (PTTW) Limits

Table 7: 2018 Lorne Park Maximum Daily Raw Water Volumes

Month	Volume (ML/Day)
January	268
February	235
March	245
April	246
May	293
June	295
July	311
August	273
September	267
October	252
November	238
December	220

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 7: 2018 Lorne Park Maximum Daily Raw Water Volumes

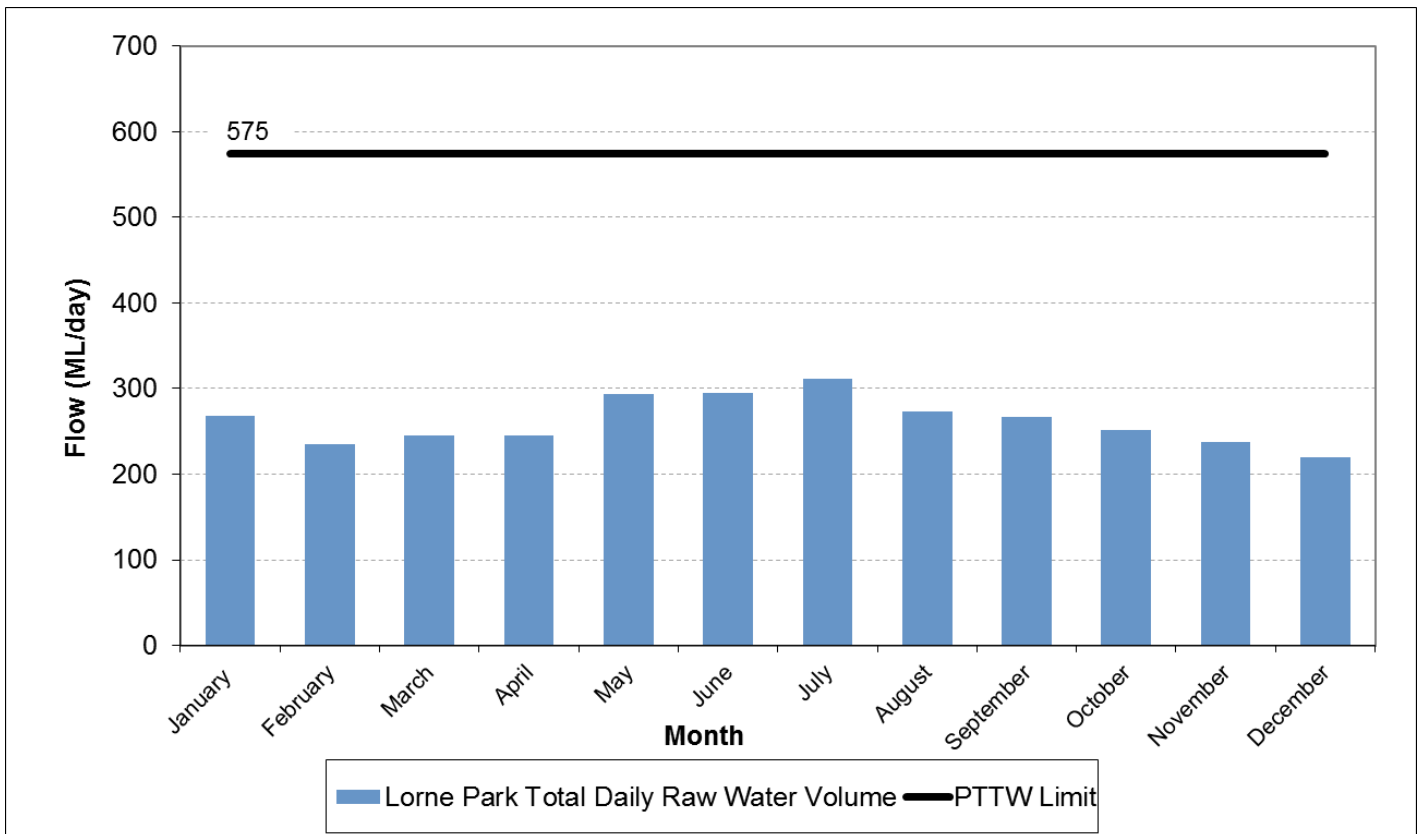

d. Maximum Daily Production and Municipal Drinking Water Licence (MDWL) Limits

Table 8: 2018 Lorne Park Maximum Daily Treated Water Volumes

Month	Production (ML/Day)
January	252
February	227
March	236
April	222
May	260
June	272
July	289
August	254
September	251
October	232
November	215
December	200

Note: 1 ML = 1,000,000 L = 1,000 m³

Figure 8: 2018 Lorne Park Maximum Daily Treated Water Production

