


**DETAIL
RESTRAINER ASSEMBLY**
N.T.S.



NOTES

1. ALL JOINTS WITHIN 11.0 METRE LENGTH EACH SIDE FROM GATE VALVE SHALL BE RESTRAINED.
2. ALL VALVES, FITTINGS AND MECHANICAL RESTRAINTS TO BE *c/w* DENSO PASTE, DENSO MASTIC AND DENSO TAPE OR APPROVED EQUAL, APPLIED TO MANUFACTURER'S RECOMMENDATIONS.

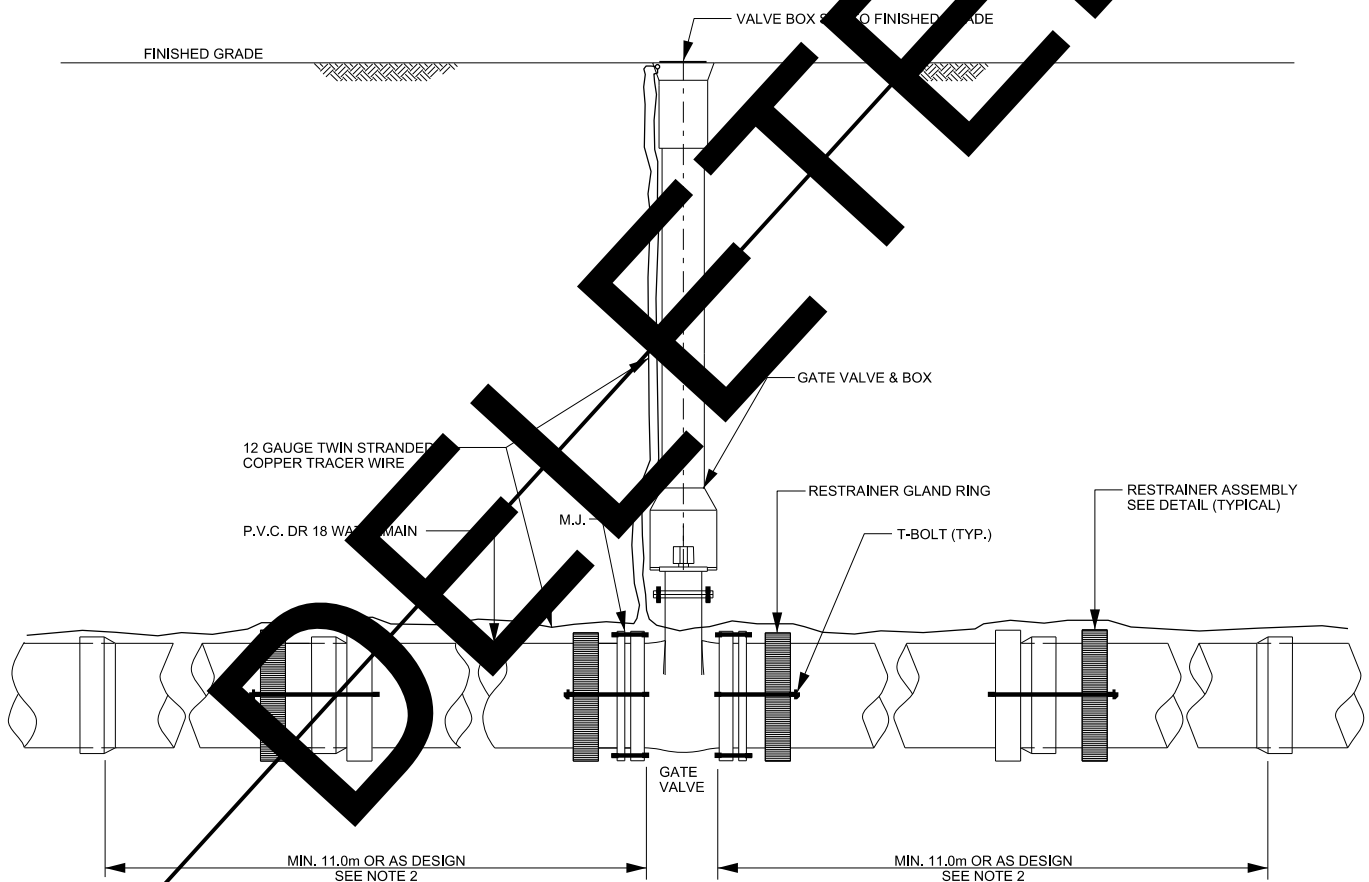

**PUBLIC WORKS
STANDARD DRAWING**

REV. DATE: NOVEMBER 2011

APPROVED BY

A.P.

STD. DWG. NUMBER

1-3-3A

DRAWN BY

AINLEY GROUP

SCALE

N.T.S.

**RESTRAINING OF 300mm DIAMETER AND SMALLER
P.V.C. WATERMAIN AT IN-LINE VALVE**