NOTE: REFER TO ALTERNATE ACCESS RISER AND COVER INSTALLATION DETAILS FOR CHAMBERS LOCATED OFF PAVEMENT

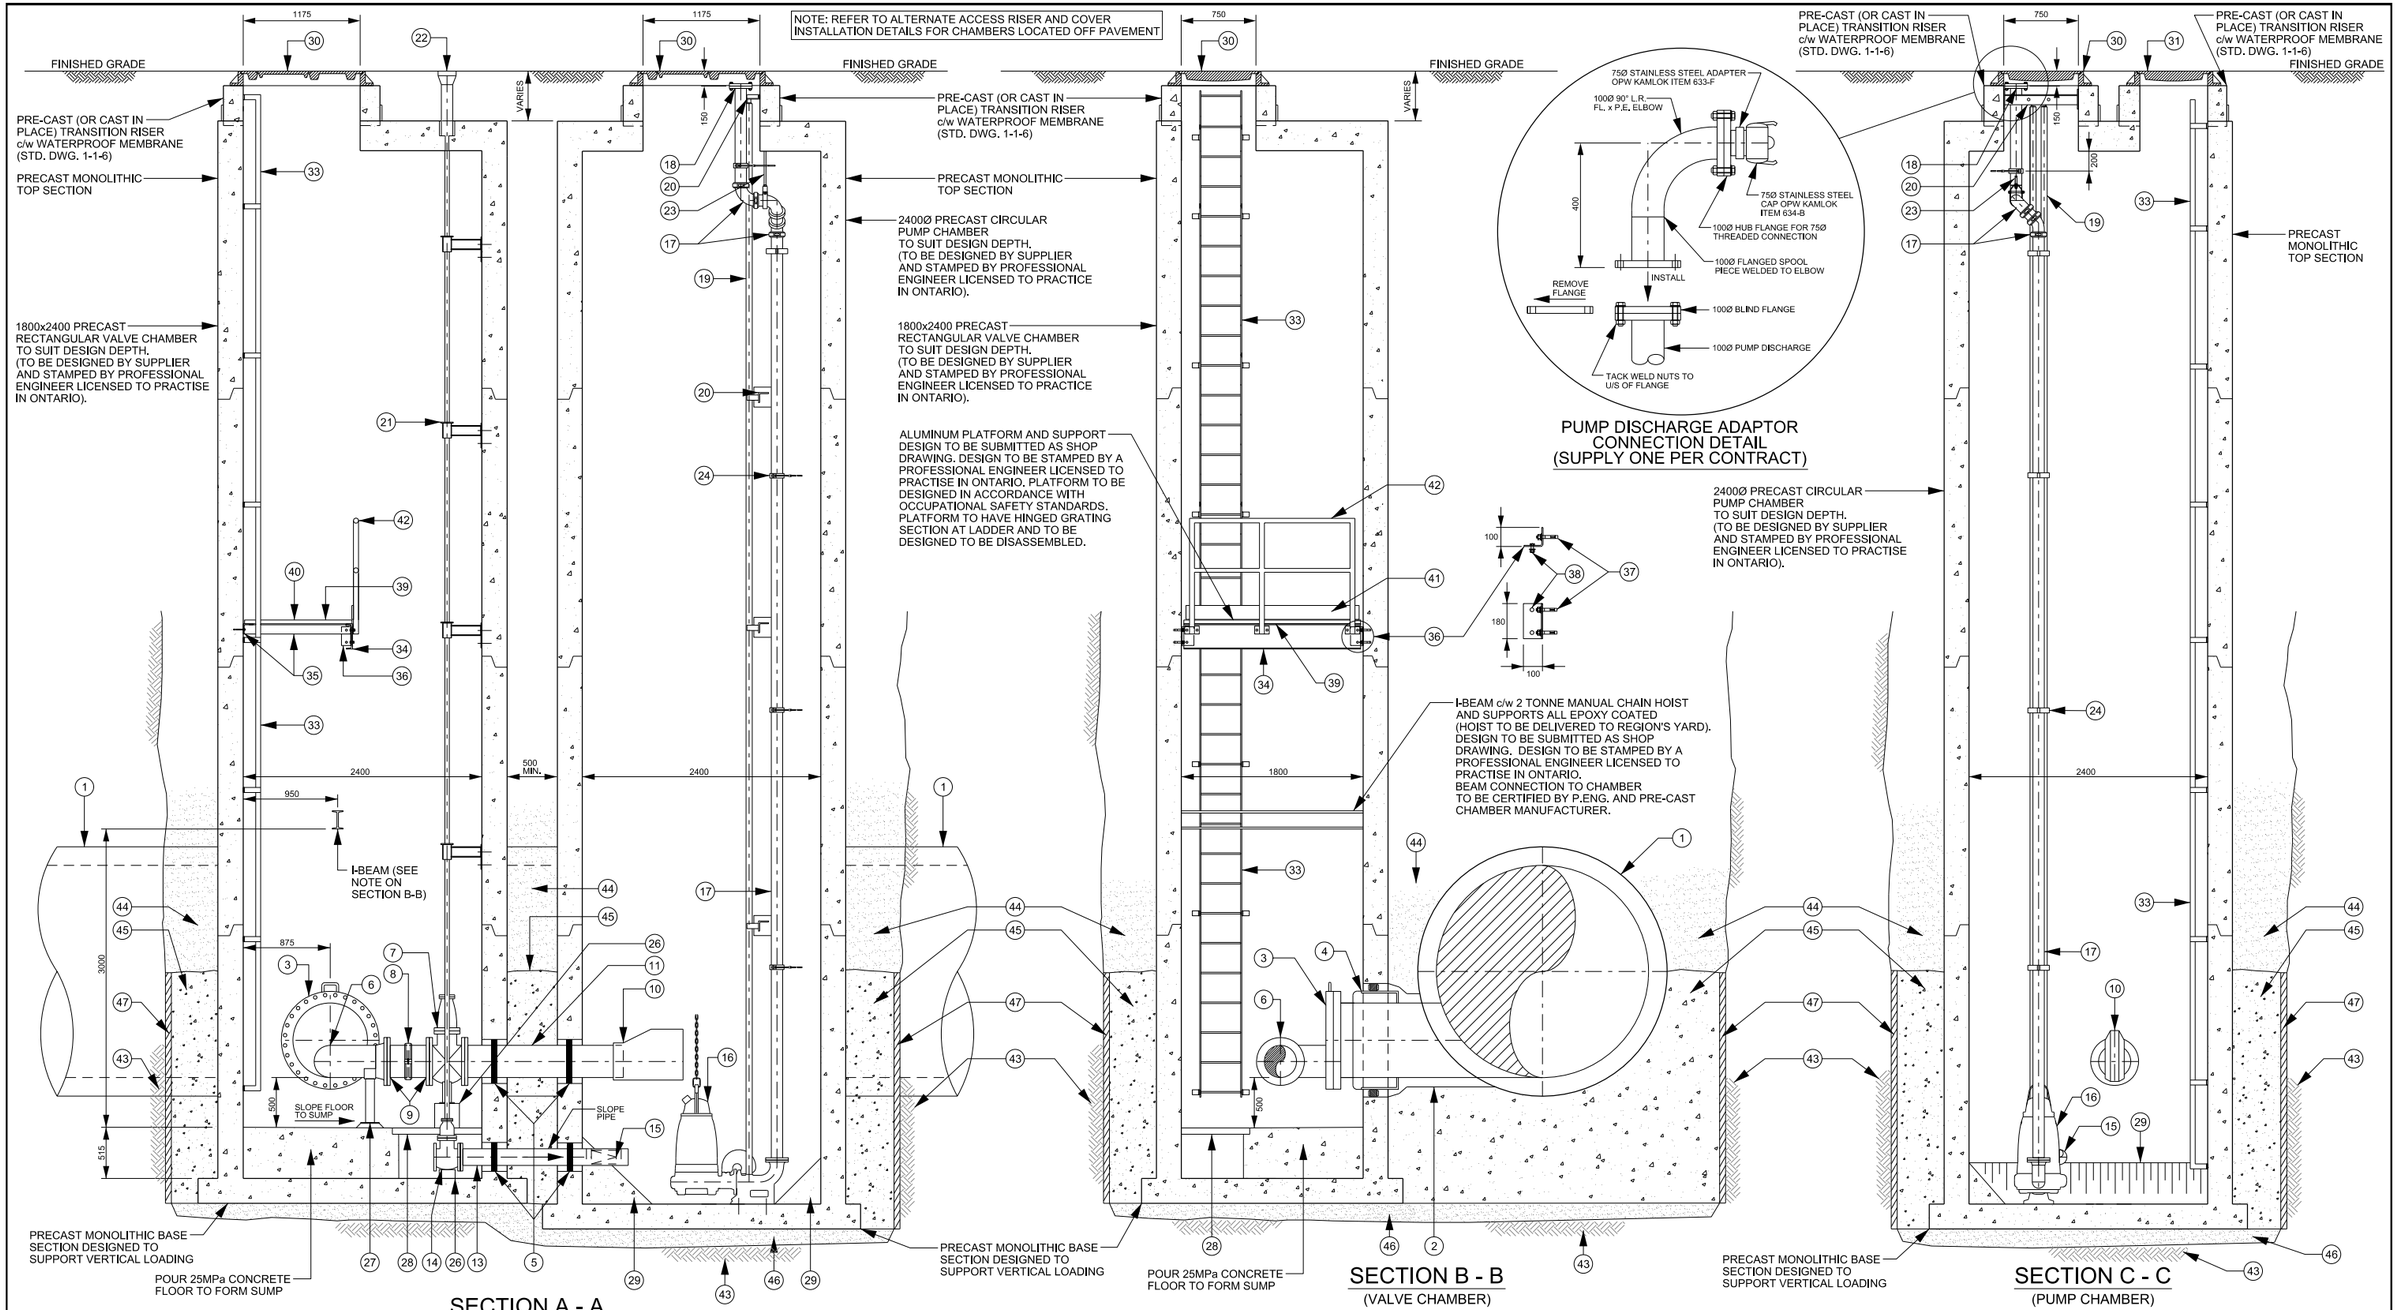

SECTION A - A
(VALVE CHAMBER & PUMP CHAMBER)

SECTION B - B
(VALVE CHAMBER)

SECTION C - C
(PUMP CHAMBER)

PUMP DISCHARGE ADAPTOR CONNECTION DETAIL (SUPPLY ONE PER CONTRACT)

NOTE

1. REFER TO TYPICAL DOUBLE DRAIN CHAMBER DETAIL 1 OF 2 (STD. DWG. 1-3-44) FOR PLAN VIEWS.
2. ALL PIPING, FITTINGS, VALVES, APPURTENANCES AND MECHANICAL RESTRAINTS TO BE c/w DENSO PASTE, DENSO MASTIC AND DENSO TAPE OR APPROVED EQUAL, APPLIED TO MANUFACTURER'S RECOMMENDATIONS.

Region of Peel working with you

PUBLIC WORKS
STANDARD DRAWING

REV. DATE: APRIL 2014

TYPICAL DOUBLE DRAIN CHAMBER FOR CONCRETE PRESSURE PIPE 750 DIAMETER OR GREATER DETAIL 2 OF 2

APPROVED BY	DRAWN BY
A.P.	AINLEY GROUP
STD. DWG. NUMBER	SCALE
1-3-45	N.T.S.