


WM SIZE	BRASS G.V.	BRASS NIPPLE	I.P.T. OUTLET WHERE REQ'D
400	25w/HANDWHEEL	25	25
600	50	50	50



**NOTES**

1. ALL THREADED PIPE FITTINGS AND VALVES MUST BE BRONZE.
2. ALL OUTLETS ARE TO BE AS SHOWN ON CONSTRUCTION DRAWINGS.
3. BRASS GATE VALVES TO HAVE RISING SPINDLES.
4. MIN. DIAMETER OF CHAMBER 1800mm. IN DOUBLE DRAIN CONFIGURATION, MINIMUM DIAMETER OF CHAMBER 2100mm.
5. AIR AND DRAIN VALVE TO BE LOCATED WITHIN CHAMBER AS DICTATED BY PIPE GRADIENT.
6. REFER TO STD DWG 1-5-3 ON THRUST FLANGE.

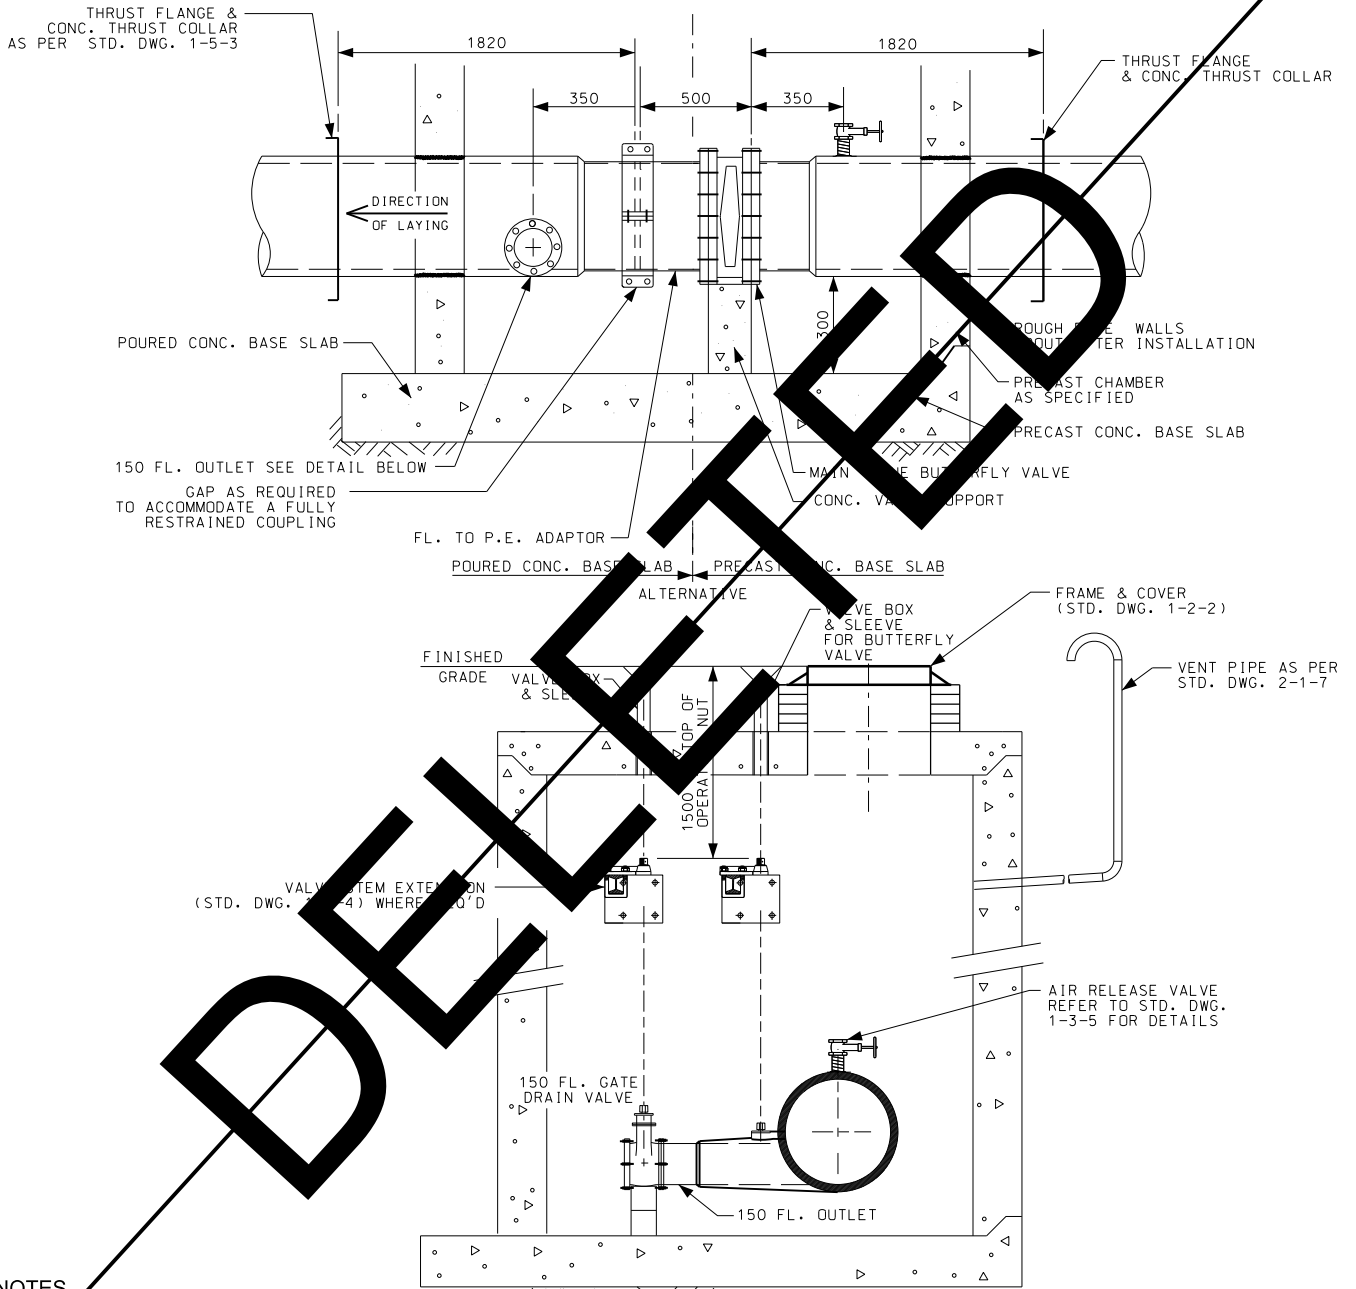

**PUBLIC WORKS  
STANDARD DRAWING**

REV. DATE: MAY 2009

APPROVED BY

DRAWN BY

A.P.

G.G.

STD. DWG. NUMBER

SCALE

**1-3-7**

N.T.S.

**VALVE SETTING FOR 400mm TO 600mm PIPE**