


CONCRETE DETAIL



NOTE

1. 50mm GALVANIZED CONDUIT SHALL BE INSTALLED FROM INSIDE CHAMBER WALL TO A SUITABLE LOCATION 2000mm MIN. OUTSIDE TRAFFIC AREA, AS PER STD. DWG. 1-2-3.
2. IF OPTIONAL BYPASS IS NOT INSTALLED, THEN SHUTDOWN OF SERVICE WILL OCCUR FOR MAINTENANCE AND REPAIR DURING NORMAL BUSINESS HOURS.
3. EXTRUDED COPPER (SOLDERED) OR GALVANIZED FITTINGS SHALL NOT BE USED. ALL FITTINGS TO BE BRASS.
4. TEST VALVE SHALL BE LOCATED BETWEEN THE OUTLET SIDE OF THE METER AND THE OUTLET SIDE ISOLATION VALVE.
5. ALL INTERNAL AND EXTERNAL VALVES, FITTINGS, THROUGH WALL METAL PIPING AND MECHANICAL RESTRAINTS TO BE c/w DENSO PASTE, DENSO MASTIC AND DENSO TAPE OR APPROVED EQUAL, APPLIED TO MANUFACTURER'S RECOMMENDATIONS.

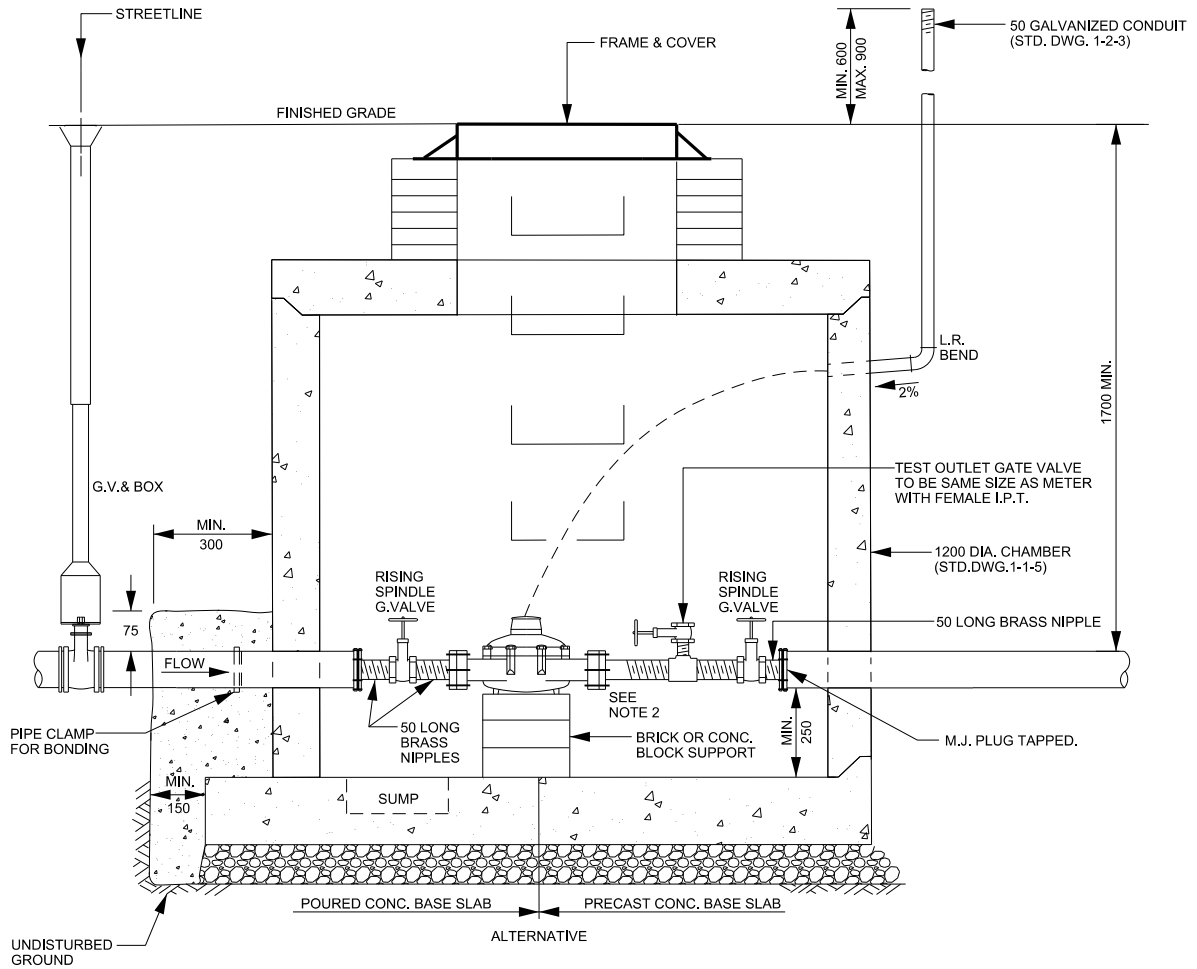

PUBLIC WORKS
STANDARD DRAWING

REV. DATE: NOVEMBER 2011

APPROVED BY

DRAWN BY

A.L.

AINLEY GROUP

STD. DWG. NUMBER

SCALE

1-4-6

N.T.S.

38mm AND 50mm T-10 METER CHAMBER
INSTALLATION ON D.I. OR P.V.C. WATERMAIN