


W = ACTUAL TRENCH WITH MEASURED ALONG THE CENTRE LINE OF THE EXISTING WATERMAIN

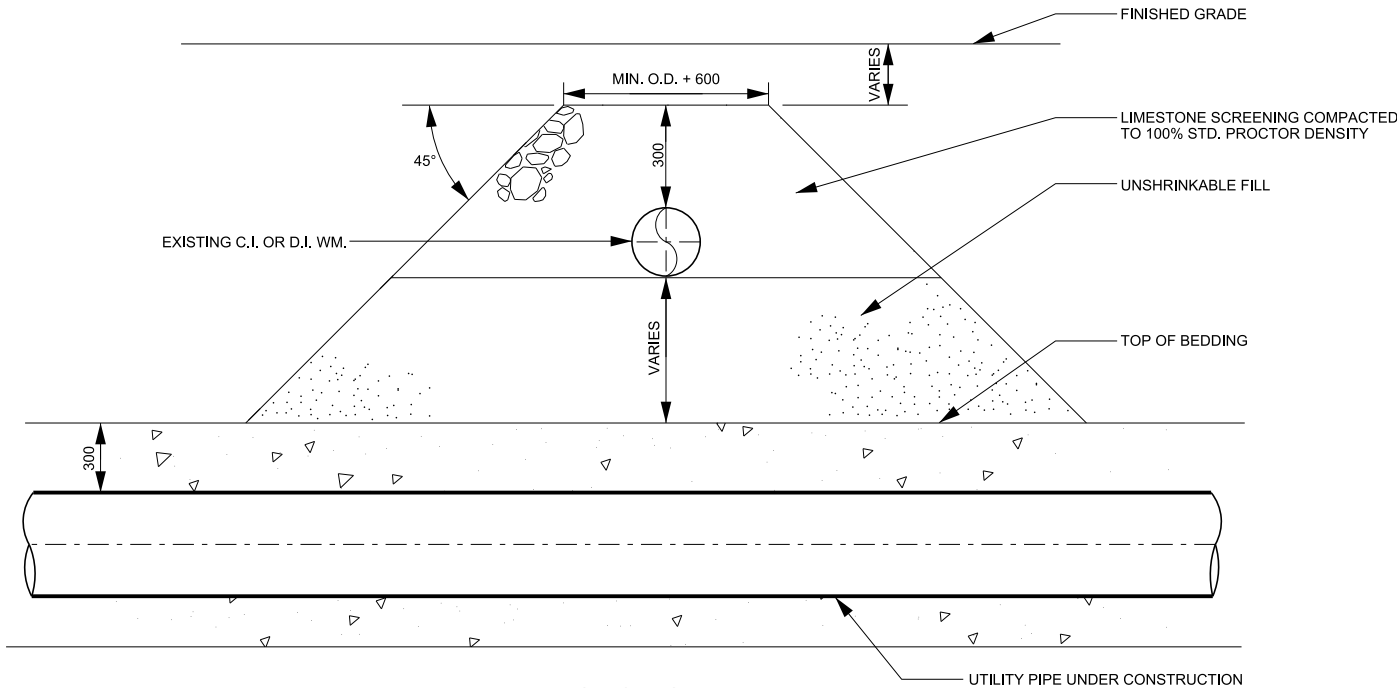

SECTION A-A

NOTE

1. ALL PIPING, FITTINGS, VALVES, APPURTENANCES AND MECHANICAL RESTRAINTS TO BE c/w DENSO PASTE, DENSO MASTIC AND DENSO TAPE OR APPROVED EQUAL, APPLIED TO MANUFACTURER'S RECOMMENDATIONS.
2. APPLICATION LIMITS FOR DENSO PASTE, DENSO MASTIC AND DENSO TAPE (OR APPROVED EQUAL) TO EXTEND BEYOND EXPOSED ANODE CONNECTION POINTS ON EXISTING D.I. OR C.I. PIPE.



**PUBLIC WORKS
STANDARD DRAWING**

REV. DATE: APRIL 2014

APPROVED BY: A.P. DRAWN BY: AINLEY GROUP

STD. DWG. NUMBER: 1-5-2A SCALE: N.T.S.

**REPLACEMENT OF C.I. OR D.I. WATERMAIN 300mm
AND SMALLER CROSSING UTILITY TRENCH**