


INTERCONNECTION	
WM SIZE	MINIMUM CONNECTION SIZE
< 300mm	50mm
>= 300mm	100mm

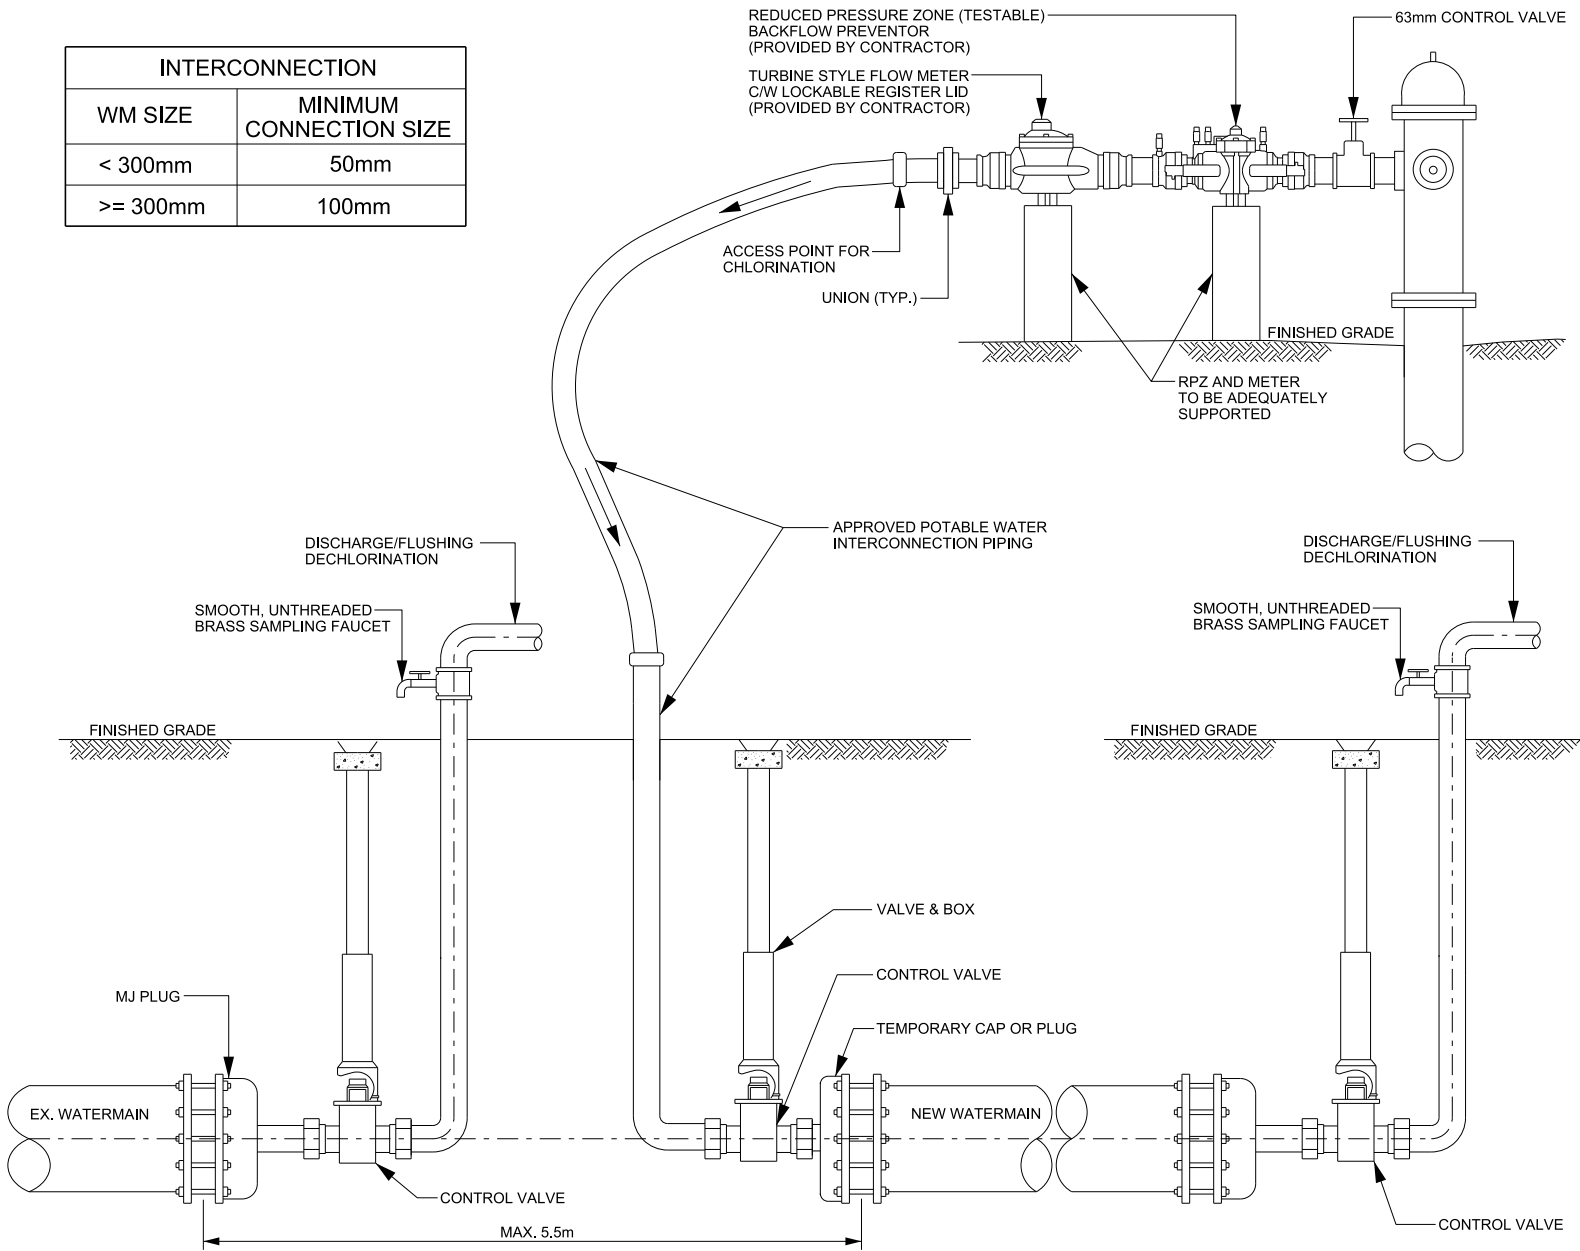

NOTE

1. THE REDUCED PRESSURE ZONE BACKFLOW PREVENTOR (RPZ) MUST BE PROVIDED BY THE CONTRACTOR AND TESTED ANNUALLY AS PER CSA B64-10. THE ANNUAL TESTING LOGS MUST BE ON SITE AND AVAILABLE FOR REVIEW BY THE AGENCY AT ANYTIME.
2. THE BACKFLOW PREVENTION VALVE AND FLOW METER ASSEMBLY SHALL BE DISCONNECTED DURING WATERMAIN PRESSURE TESTS.
3. THE FINAL CONNECTION OF THE WATERMAIN SHALL BE COMPLETED ONLY AFTER AUTHORIZATION BY REGION OF PEEL.
4. THE WATERMAIN SHALL BE DRAINED BY CONTROLLED MEANS AND TEMPORARY CAP OR PLUGS INSTALLED AS REQUIRED. SUFFICIENT TRENCH DEWATERING CAPACITY SHALL BE USED WHEN THE EXISTING AND NEW WATERMAINS ARE DRAINED PRIOR TO THE FINAL CONNECTION TO ENSURE NO BACKFLOW OF TRENCH WATER INTO EITHER WATERMAIN.
5. THE WATERMAIN SHALL BE CUT BACK TO REMOVE THE TAPPING POINTS OF THE BACKFLOW PREVENTION VALVE ASSEMBLY. ENSURE COMPLETION PIECE IS LESS THAN 5.5m AND DISINFECTED ACCORDING TO AWWA 651-05.
6. ONLY MUNICIPAL STAFF SHALL OPERATE MUNICIPALITY OWNED VALVES.
7. ALL NEW PIPING AND APPURTENANCES PLACED IN THE CONNECTION SHALL BE THOROUGHLY DISINFECTED WITH 1-5% SOLUTION OF SODIUM HYPOCHLORITE SOLUTION (ANSI/NSF60 CERTIFIED) ACCORDING TO AWWA C651.
8. A PHYSICAL SEPARATION MUST BE MAINTAINED AT ALL CONNECTION POINTS OF NEW WATERMAINS TO THE EXISTING SYSTEMS UNTIL BACTERIOLOGICAL TESTS HAVE PASSED. A SAMPLING TAP MUST BE PROVIDED AT THE END OF EACH BRANCH OR STUB.
9. THIS DETAIL IS FOR SCHEMATIC INFORMATION ONLY. THE ACTUAL CONFIGURATION USED MUST SATISFY THE INTENT OF THIS DRAWING.
10. FREEZING PROTECTION MUST BE PROVIDED WHEN APPLICABLE. INSULATION IS REQUIRED BETWEEN FROST BOX & GROUND TO PREVENT ADHERENCE TO GROUND.
11. ALL TEMPORARY CAPS TO BE EITHER RESTRAINED OR APPROVED ALTERNATIVE. ALL RESTRAINED JOINTS AS PER PIPE MANUFACTURER'S SPECIFICATION.
12. RPZ AND FLOW METER TO BE LOCATED IN THE BOULEVARD.