


TRENCH PLUGS SHALL BE INSTALLED AT MINIMUM 100m INTERVALS UNLESS PROJECT SPECIFIC DESIGN INDICATES OTHERWISE

UNSHRINKABLE CONCRETE MAY BE USED AS AN ALTERNATE TO BENTONITE CLAY PLUG

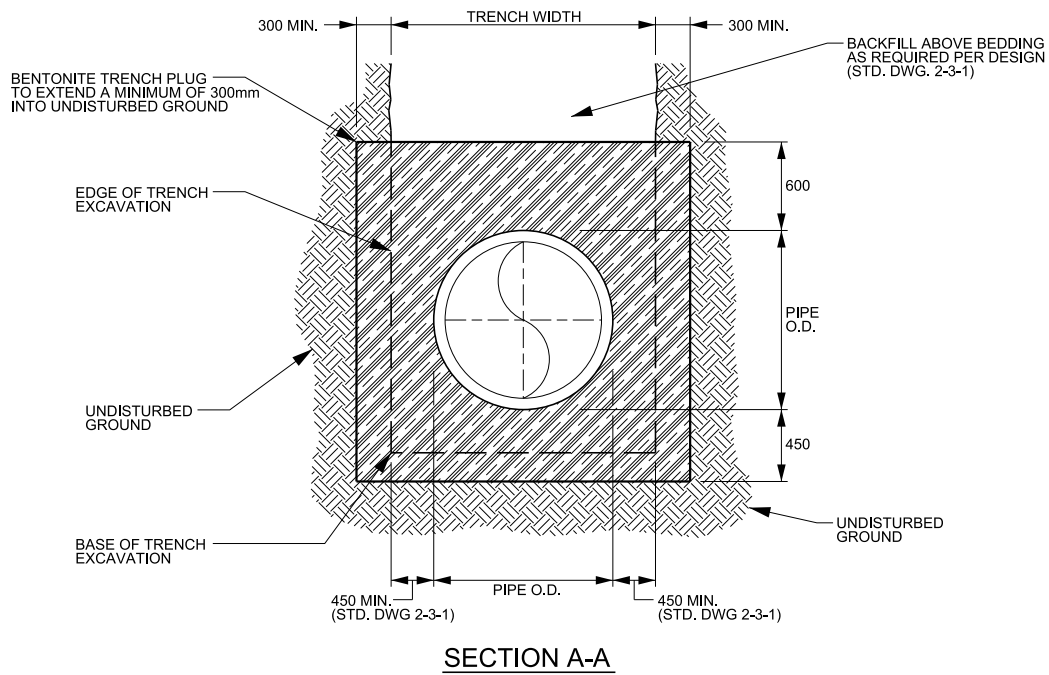

**NOTE**

1. REFER TO STANDARD DRAWING 2-3-1 FOR BEDDING DETAILS FOR SEWERS.
2. FOR TRENCH PLUG LOCATIONS REFER TO CONTRACT SPECIFICATIONS AND PROJECT SPECIFIC REQUIREMENTS.



**PUBLIC WORKS  
STANDARD DRAWING**

REV. DATE: NOVEMBER 2019

REVISION NUMBER: FOR REVISION TRACKING REFER TO STD. DWG. 2-0-2

APPROVED BY

DRAWN BY

A.P.

AINLEY GROUP

STD. DWG. NUMBER

SCALE

**2-3-2**

N.T.S.

**BENTONITE TRENCH PLUG DETAIL**