


A ←
PLAN

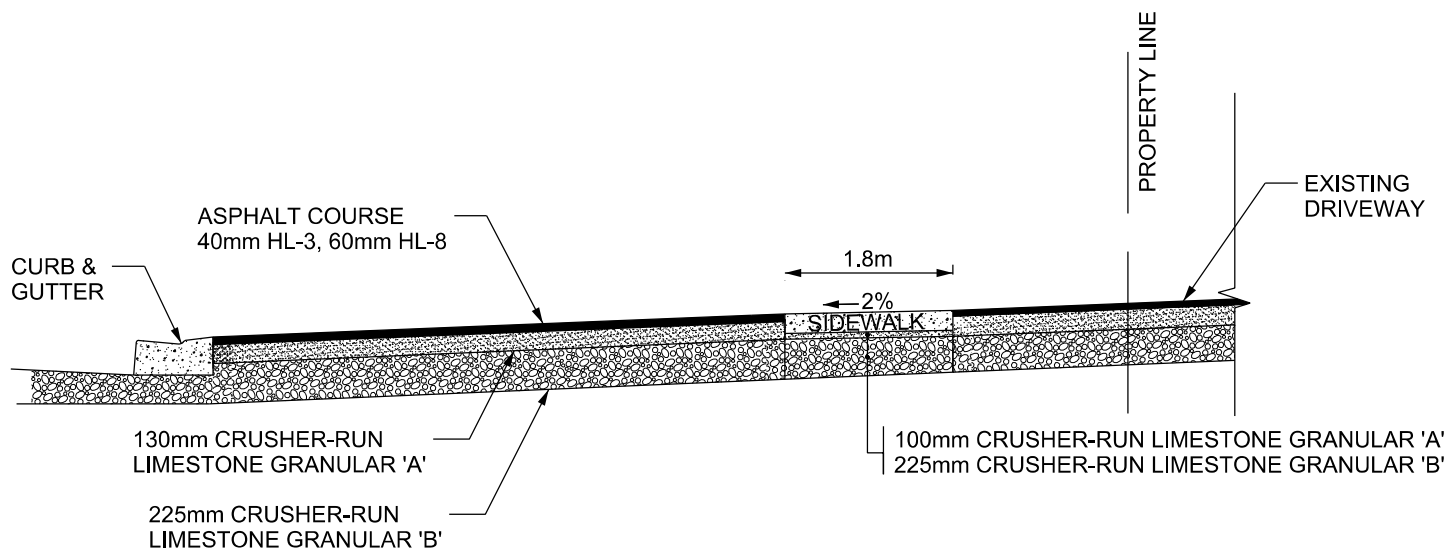

SECTION A - A

NOTES

1. ALL TOPSOIL AND SOD TO BE REMOVED FROM LIMITS OF PROPOSED DRIVEWAY
2. GRANULAR TO BE COMPACTED TO 100% S.P.D.
3. MAXIMUM DRIVEWAY GRADE: 6%
4. THICKNESS OF CONCRETE SIDEWALK AT DRIVEWAY SHALL BE 130mm AS REFERENCED ON 5-2-6

ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.



**PUBLIC WORKS
STANDARD DRAWING**

DATE: MARCH 2015

APPROVED BY

DRAWN BY

G.K./S.L.

O.A.

STD. DWG. NUMBER

SCALE

5-1-9

N.T.S.

**RESIDENTIAL DRIVEWAY ENTRANCE WITHIN
URBAN ROAD CROSS SECTION**