



CLASS 'B'

LOAD FACTOR 1.9

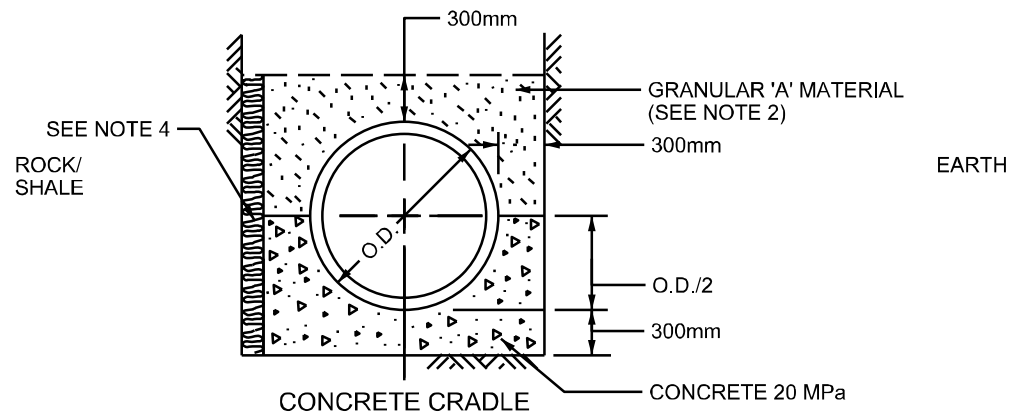

CLASS 'A'

LOAD FACTOR 2.8

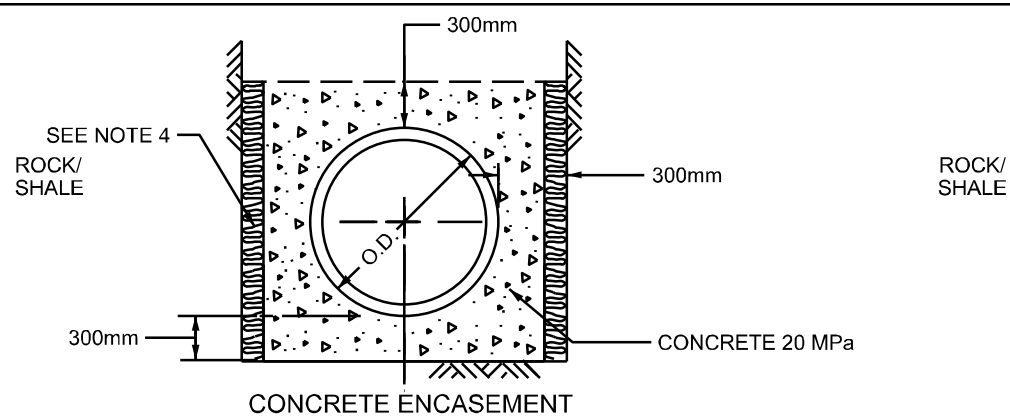

CLASS 'AA'

LOAD FACTOR 4.5

NOTES

1. THIS DRAWING MUST BE USED IN CONJUNCTION WITH TRENCH RESTORATION DETAILS, STANDARD DRAWINGS 5-2-2A AND 5-2-2B
2. GRANULAR 'A' MATERIAL SHALL BE PLACED AS BEDDING AND COVER MATERIALS IN 150mm LIFTS USING A MECHANICAL COMPACTION EQUIPMENT OR EQUIVALENT TO ACHIEVE 100% SPMDD
3. WHEN SUBBASE IS SATURATED (IN WET CONDITIONS ONLY), MINIMUM 300mm OF HL6 GRADED STONE (75% FRACTURED FACE) MUST BE USED AS A LEVELING COURSE
4. IN ROCK OR SHALE EXCAVATION, PROVIDE 50mm THICK HIGH DENSITY POLYSTYRENE LAYER BETWEEN THE TRENCH WALLS AND THE CONCRETE ENCASUREMENT/BACKFILL MATERIAL ALONG THE SIDE OF TRENCH
5. ALL BEDDING AND BACKFILL MATERIALS SHALL BE APPROVED BY THE ENGINEER



**PUBLIC WORKS
STANDARD DRAWING**

DATE: JUNE 2016

APPROVED BY

DRAWN BY

G.K./S.L.

C.B.

BEDDING DETAILS FOR STORM SEWER

STD. DWG. NUMBER

SCALE

5-2-18

N.T.S.