


TABLE

PIPE SIZE IN	METER SIZE	PIPE SIZE OUT	'A'
38mm	25mm	25mm	273mm
50mm	38mm	38mm	330mm
75mm	50mm	50mm	432mm
100mm	75mm	75mm	432mm
—	75mm STRAINER	—	152mm

SECTION A-A

STANDPIPE DETAIL

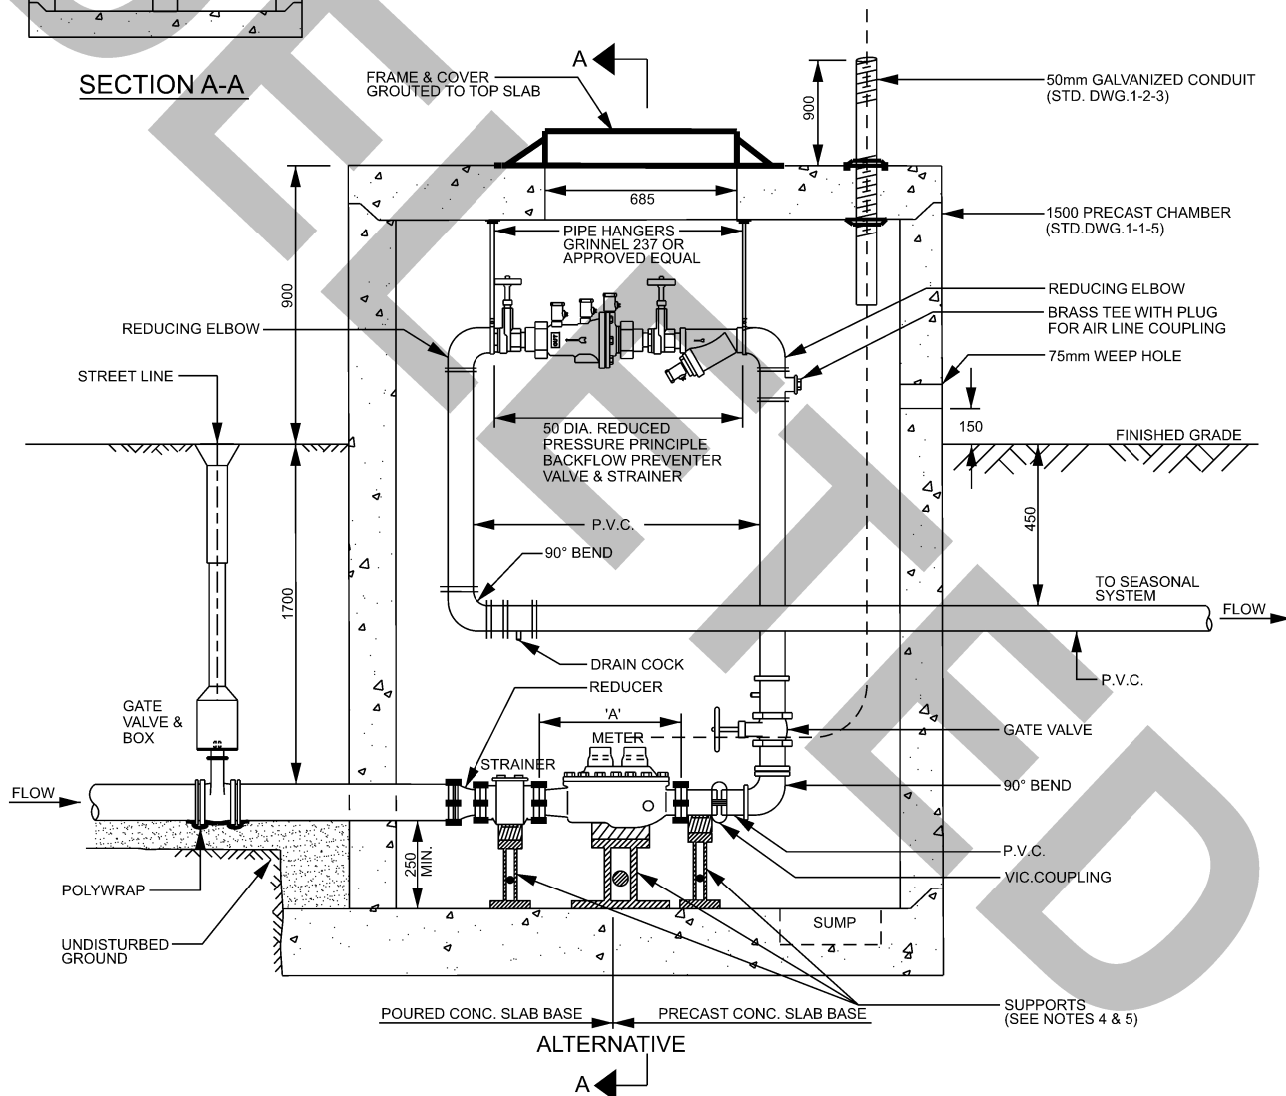

ALTERNATIVE

NOTES

1. VENT ON REDUCED PRESSURE PRINCIPAL BACKFLOW PREVENTER SHALL BE 300mm ABOVE WEEP HOLE. WEEP HOLE TO BE 150mm ABOVE FINISHED GRADE.
2. IF METER SIZE IS LESS THAN 75mm, THEN A TEST OUTLET GATE VALVE SHALL BE INSTALLED (STD.1-4-6) ON OUTLET SIDE OF METER.
3. ALL INTERNAL AND EXTERNAL VALVES, FITTINGS, THROUGH WALL METAL PIPING AND MECHANICAL RESTRAINTS TO BE c/w DENSO PASTE, DENSO MASTIC AND DENSO TAPE OR APPROVED EQUAL, APPLIED TO MANUFACTURER'S RECOMMENDATIONS.
4. ALL PIPING, FITTINGS AND METER SHALL BE SUPPORTED INDEPENDENTLY OF EACH OTHER.
5. PIPING SHALL BE BRACED TO MAINTAIN ALIGNMENT OF PIPE AND FITTINGS, PREVENT SWAYING, AND CONTROL THRUST. ALL SUPPORT MATERIALS SHALL BE COMPATIBLE WITH PIPE MATERIAL AND, CORROSION RESISTANT WHEN INSTALLED IN WET ENVIRONMENT.
6. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE SPECIFIED.



PUBLIC WORKS
STANDARD DRAWING

REV. DATE: NOVEMBER 2025

APPROVED BY

A.M.

STD. DWG. NUMBER

1-4-17

DRAWN BY

PEEL CAD TEAM

SCALE

N.T.S.

METER CHAMBER FOR SEASONAL SYSTEM